


Agave-SH-ULTRA

Single Phase Hybrid Inverter

User Manual

A horizontal bar composed of three segments: a green segment on the left, a blue segment in the middle, and a dark blue segment on the right.

SIA-3.6kW Series
SIA-4.6kW Series
SIA-5kW Series
SIA-6kW Series
SIA-8kW Series
SIA-10kW Series

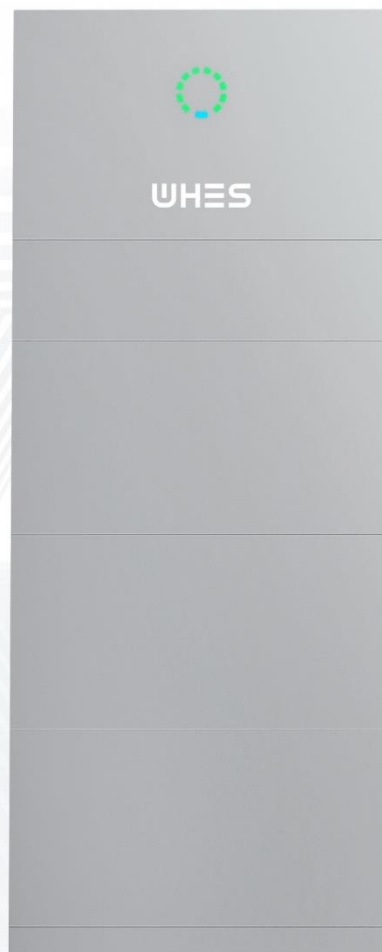

COPYRIGHT

Copyright © Weiheng Intelligent Technology Co., Ltd. All rights reserved.

Any corporation or individual should not plagiarize, partially or fully copy, and no reproduction or distribution of it in any form or by any means. All rights reserved. Please properly store the manual and strictly follow all safety and operating instructions provided. Please do not operate the system before reading through this manual.

Trademarks

UHES and other symbol or design (brand name, logo) that distinguishes the products or services offered by Weiheng Intelligent Technology Co., Ltd. have been trademark protected. Any unauthorized use of the above stated trademark may infringe the trademark right.

Notice

The information in this user manual is subject to change due to product updates or other reasons. This guide cannot replace the product labels or the safety precautions in the user manual unless otherwise specified. All descriptions here are for guidance only.

Weiheng Intelligent Technology Co., Ltd.

Address: Luoshe Town, Huishan District, Wuxi, Jiangsu Province, China (80m Northeast of the Intersection of Jianghai West Road and Luonan Avenue)

Postal Code: 214000

Website: www.whes.com

ABOUT THIS MANUAL

This manual is valid for Agave-SH-Ultra system which includes hybrid inverter SIA Series and battery Myrtillo.

It describes the information, installation, electrical connection, commissioning, and maintenance and troubleshooting of the product. All the installers and users must be familiar with the product features, functions, and safety precautions. This manual is subject to update without notice. For more product details and latest documents, visit <https://www.whes.com/en>.

Conventions

Symbol	Description
	It indicates a hazard with a high level of risk that, if not avoided, will result in death or serious injury.
	It indicates a hazard with a moderate level of risk that, if not avoided, could result in death or serious injury.
	Indicates a hazard with a low level of risk that, if not avoided, could cause minor or moderate injury.
	It is used to emphasize important/critical information, best practices, and tips. The "NOTE" symbol is not a safety warning and does not refer to personal injury, equipment damage, or environmental hazards.

Revision History

V1.0 2025-03-04:

- First Issue.

V1.1 2026-09-01:

- Added battery information for the 100% DOD version.

CONTENTS

COPYRIGHT	1
ABOUT THIS MANUAL.....	1
1 SAFETY	1
1.1 General Safety Statement.....	1
1.2 Target Group.....	2
1.3 Symbols in the Manual.....	2
2 SAFETY	4
2.1 Important Safety Instructions.....	4
2.2 Safety Warning.....	4
2.3 Limitation of Liability.....	5
3 INTRODUCTION.....	6
3.1 Product Overview	6
3.2 Features.....	7
3.3 Application Scenarios.....	7
3.4 Dimensions.....	8
3.5 Indicator Status and Communication Port	9
3.6 Product identity definition	12
3.7 Technical Data.....	13
4 INSTALLATION	16
4.1 Packing List	16
4.2 Installation Location and Environment.....	18
4.2.1 General.....	18
4.2.2 Location Restrictions	19
4.2.3 Barriers to Habitable Rooms.....	19
4.2.4 Choosing an Installation Location.....	21
4.3 Installation Steps.....	22
4.4 Cable Connections	30
4.4.1 General.....	30
4.4.2 Connect the Inverter Box and Battery Box	30
4.4.3 System Connection Diagrams.....	38
5 System Operation.....	39
5.1 Turning on the system.....	39
5.2 Turning off the system	40
6 ECOS CONFIGURATION & WI-FI RELOAD	41
6.1 Preparations	41
6.2 Wi-Fi Reset & Restore.....	42
6.3 Change Password & Delete Account.....	44
7 EMS CONFIGURATIONS.....	46

8	TROUBLESHOOTING	47
9	EMERGENCIES.....	51
9.1	Emergency Procedures	51
9.2	First Aid Procedures	51
9.3	Firefighting Measures	51
10	Remarks	52
10.1	Recycle and Disposal	52
10.2	Maintenance	52

1 SAFETY

1.1 General Safety Statement

Please thoroughly read this manual before installing, operating, and maintaining the equipment, and follow the markings present on the equipment, as well as all safety precautions outlined in this manual.

The "DANGER", "WARNING", "CAUTION" and "NOTE" instructions contained in this manual do not cover all safety considerations that need to be observed but are only intended to supplement all safety precautions. Weiheng disclaims any liability for damages resulting from failure to comply with general safe operation requirements or from violation of safety standards applicable to the design, production, and use of the equipment.

This equipment must be used in an environment that meets the design specifications, otherwise the equipment may fail, resulting in equipment malfunctions, component damage, personal safety accidents, property losses, etc., which are not covered by the quality warranty.

Be sure to install, operate and maintain the equipment in accordance with local laws, regulations, and specifications. The safety precautions contained in this manual are intended only to supplement local laws and regulations.

Weiheng shall not be held liable in any of the following circumstances:

- Installing or operating the equipment in an environment that exceeds applicable international, national, or local standards;
- Failure to operate the equipment under the conditions specified in this manual;
- Unauthorized disassembly, modification of the product or alteration of the software codes;
- Failure to operate the equipment in accordance with the operating instructions and safety warnings present on the product or outlined in the document;
- Damage to the equipment caused by abnormal natural environment (force majeure, such as earthquake, fire, storm, flood, mudslide);
- Damage caused by customer failure to comply with transport and installation requirements;
- Damage caused by storage conditions not meeting the requirements specified in the product document;
- Damage to the hardware or data of the equipment due to customer negligence, improper operation or intentional damage;

- Damage to the system caused by third parties or customers, including relocation and installation of the system not in accordance with the requirements of this manual, and adjustment, modification, or removal of identification marks not in accordance with the requirements of this manual;
- Defects, failures or damage caused by acts, events, negligence or accidents beyond the reasonable control of the Seller, including power outages or electrical failures, theft, war, riots, civil commotion, terrorism, intentional or malicious damage, etc.

1.2 Target Group

This manual applies to qualified electricians. The qualified electricians have to be familiar with the product, local standards, and electric systems. The tasks described in this manual should only be performed by qualified electricians. End users can also use this manual to understand the product and functions.

1.3 Symbols in the Manual

Important instructions contained in this manual should be followed during installation, operation and maintenance.

The following types of warning and safety symbols appearing on the product are described below:



Potential risks exist.

Wear proper PPE before any operations.



Danger to life due to electric shock

The product operates at high voltages. All work on the product must be carried out by qualified persons only.



Risk of burns due to hot surfaces

The product can get hot during operation. Avoid contact during operation. Allow the product to cool down sufficiently before carrying out any work.



Heavy objects. Lift with care.



Keep the battery from open fire or ignition sources.



Recyclable product components.



This side up. The package must always be transported, handled, and stored upright, with the arrows pointing upwards.



Do not stack more than five identical packages on top of each other.



WEEE designation

Do not dispose of the product together with the household waste but in accordance with the locally applicable disposal regulations for electronic waste.



Handle the package/product with care, and do not tip it over or throw it.



Observe the documentation

Observe all documentation supplied with the product.



Keep dry

The package/product must be protected from excessive humidity and stored covered.



CE marking

The product complies with the requirements of the applicable EU directives.

2 SAFETY

2.1 Important Safety Instructions

This manual contains important instructions for Agave-SH Ultra system that should be followed during installation and maintenance.

The BESS is designed and tested in accordance with applicable safety requirements. Read and follow all safety instructions and precautions before performing any operation. Improper operation may result in personal injury or property damage.

2.2 Safety Warning

- The product must only be installed or operated by qualified electricians in compliance with local grid authority or company standards, wiring rules, and requirements.
- Disconnect all batteries and AC power sources from the product for at least 5 minutes before connecting any wires or conducting any electrical work to ensure the product is completely isolated and to avoid electric shocks.
- The surface of the product may exceed temperatures of 60°C during operation. Please make sure it has cooled down before touching it, and make sure that the product is out of the reach of children.
- The product must be used and operated as described in this user manual, or safety features may not work as intended, and the warranty for the product will be voided.
- The warranty will be voided if you open the product cover or change any component without eCactus's authorization.
- Care must be taken to protect the product from static damage. The WEIHENG Limited Warranty does not cover any damage caused by static.
- Neutral continuity is NOT maintained internally and must be achieved through external connections, as shown in the system connection diagram for Australia on page 39 section 4.4.3.
- The product features a built-in residual current monitoring unit (RCMU).
If the external RCD must be installed according to the local regulations, a type A RCD of action current 30mA or higher is sufficient. If local regulations explicitly require a type B RCD, a type B RCD shall be installed.
- This product features active anti-islanding protection, and inverter frequency is shifted away from nominal conditions in the absence of a reference

frequency (frequency shift).

- This product is a multimode inverter designed to be used in unconditioned outdoor shaded environments. The maximum operating ambient temperature is 55°C.
- An error message will be sent to the ECOS app in the event of a ground fault, and the status indicator on the product will turn red.

2.3 Limitation of Liability

WHES assumes no direct or indirect liability for any product damage or property losses caused by the following.

- Product modifications, design changes, or parts replaced without eCactus's authorization;
- Modifications or attempted repairs or removal of serial numbers or seals by non-WHES technicians;
- System designs and installations not in compliance with standards or regulations;
- Damage caused during transportation (including scratched paint caused by the product rubbing against the packaging during shipping). Any claims for damage during shipping should be made directly with the shipping or insurance company as the container/package is unloaded and damage is identified;
- Failure to follow any/all of the user manual, installation guide, or maintenance guidelines;
- Improper use or misuse of the device;
- Insufficient ventilation around the device;
- Product maintenance not done to acceptable standards;
- Force majeure (including severe or stormy weather, lightning, and fires).

3 INTRODUCTION

3.1 Product Overview

The product includes a hybrid inverter with battery, it can be applied in DC coupled system, AC coupled system, and off-grid (with generator) system. It can store and release the energy from solar or grid according to the requirements of built-in EMS. With backup function, it can supply power to critical loads in case of power outage. This manual contains important instructions for Agave-SH Ultra all-in-one energy storage system that should be followed during installation and maintenance.

This manual applies to the listed parts of the product below:

Inverter

Product code	Model	Name	Description
Agave-SH Ultra Hybrid	SIA-3.6kW	Agave-SH Ultra Series 3.6kW Single Phase Hybrid Inverter	Used in combination with PV panels and Agave-SH Ultra BAT for photovoltaic storage systems
	SIA-4.6kW	Agave-SH Ultra Series 4.6kW Single Phase Hybrid Inverter	
	SIA-5kW	Agave-SH Ultra Series 5kW Single Phase Hybrid Inverter	
	SIA-6kW	Agave-SH Ultra Series 6kW Single Phase Hybrid Inverter	
	SIA-8kW	Agave-SH Ultra Series 8kW Single Phase Hybrid Inverter	
	SIA-10kW	Agave-SH Ultra Series 10kW Single Phase Hybrid Inverter	

Battery Pack


Product code	Model	Name	Description
Agave-SH Ultra BAT Controller	HBC571-I	Agave-SH Ultra Series High Voltage Box	Used for data transmission and instruction delivery between

	HBC571-P (100% DoD Version)		battery and inverter
Agave-SH Ultra BAT	WH-BXC4992	Agave-SH Ultra Series 4.992kWh Battery Box	Store and release energy
	BXC-4.992kWh (100% DoD Version)		

3.2 Features


- Max 32/32A DC input current per string, compatible with 210 PV modules.
- Cable free connection, saving 75% installation time between modules.
- IP65, indoor or outdoor application. <25dB, no noise pollution.
- Maximum of 5 units in parallel, covering a capacity range up to 100kWh.
- 4-layer protection design. Long life cell, The most stringent safety testing-UL 9540A.
- VPP, EV and Diesel Generator ready. Remote updates & self-diagnosis.

3.3 Application Scenarios

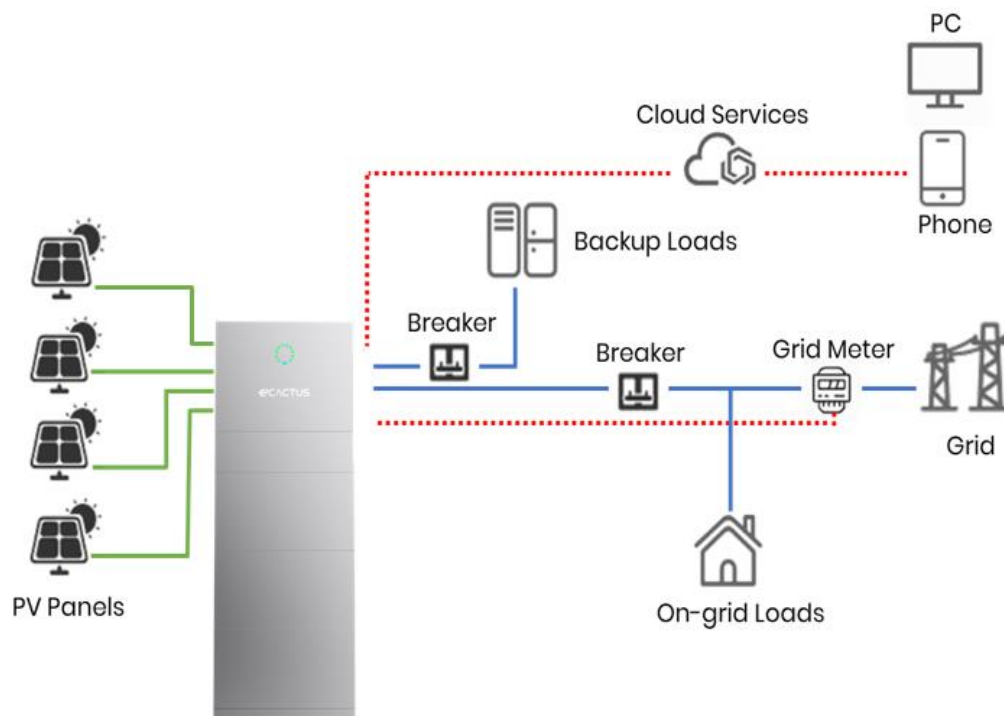


*For AC coupled system, additional PV meter is required to monitor the existing inverter.

3.4 Dimensions

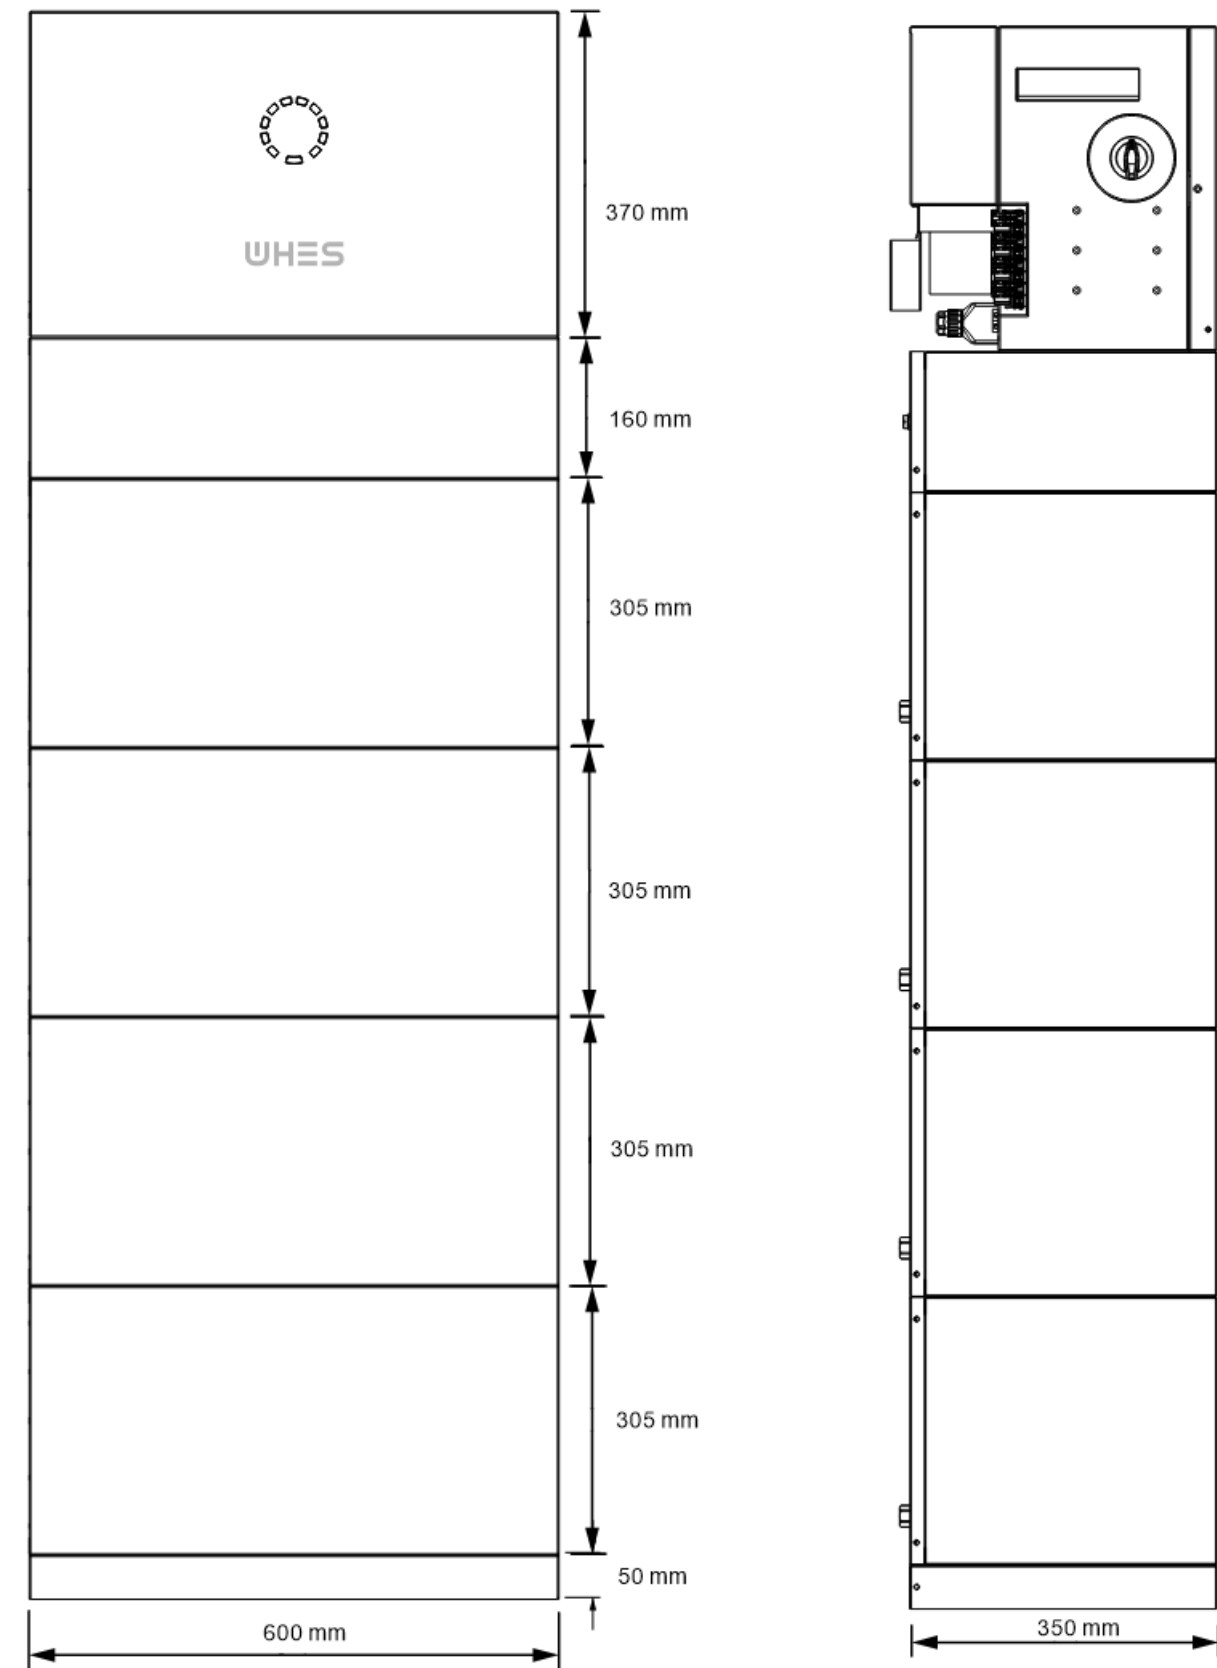

3.5 Indicator Status and Communication Port

- System appearance

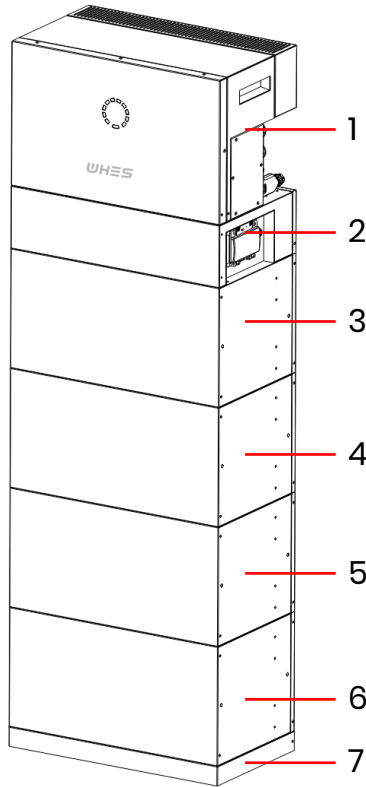


NOTICE

Ensure that the high voltage box is installed above the battery boxes. Do not install any battery box above the high voltage box.

This manual will show you the installation and electrical connection of 4 battery boxes.


NO.	Parts
1	Hybrid inverter
2	High voltage box
3, 4, 5, 6	Battery box
7	Base

- Battery appearance

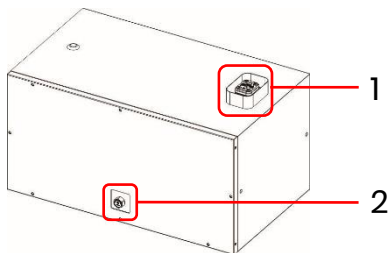



NO.	Parts
1	Guided quick connector
2	Leak valve

- Base appearance




NO.	Parts
1	Guided quick connector
7	Base

- High voltage box appearance

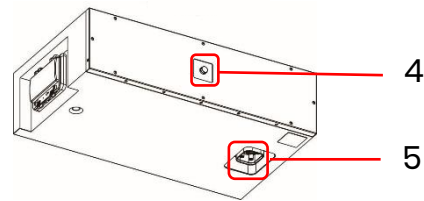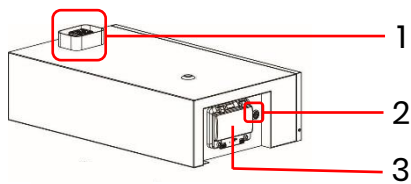

No.	Name	Definition
1, 5	Guided quick connector	Power and communication interface between modules
2	Multifunction button	Black start mode: When there is no PV and grid, press and hold for 5 seconds to start the system and drive the inverter to work. Power off mode: When the system is powered on, press and hold for 5 seconds to turn off the system. If you hear a click, it means the system has been powered off. After turning off via this button, if you want to turn it on again, please press and hold the button for 5 seconds. Note After the system is installed for the first time, there is no need to turn it on via this button. Please refer to Chapter 5.2 to turn it on via the DC breaker.
3	DC breaker	The master switch of the battery system, you must switch on it before power on the system; Short circuit protection
4	Leak valve	Battery module safety protection device

- Hybrid inverter appearance

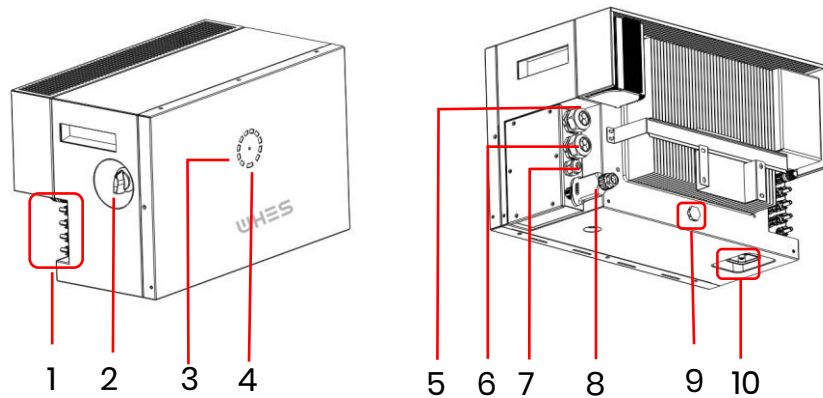

NO.	Parts	NO.	Parts
1	PV connectors	6	Grid connectors
2	PV switch	7	Communication port
3	Charge indicator	8	Wi-Fi dongle
4	Status indicator	9	Leak valve
5	EPS connectors	10	Guided quick connector

LED INDICATOR:

STATUS		LED INDICATOR	
Standby		Flashing blue LED, 2-second intervals	
Checking		Flashing blue LED, 0.5-second intervals	
Normal		Solid blue LED	
DSP fault		Solid red LED	
Battery com. fault		Flashing red LED, 2-second intervals	
Meter com. fault		Flashing red LED, 0.5-second intervals	
Charge indicator			

The Status indicator will be solid blue when everything is ready, and the Charge indicator indicates battery power.

3.6 Product identity definition

PCS Nameplate:



Hybrid Inverter:

Type	SIA-10kW
------	----------

PV INPUT

Max. PV input power(W)	20000
Max. input voltage(d.c.V)	600
MPPT voltage range (d.c.V)	50...560
Max. input current (d.c.A)	16*4
Isc PV (d.c.A)	22*4

BATTERY

Battery type	LFP
Battery Voltage Range(d.c.V)	80...500
Max. Charge/Discharge Current(d.c.A)	50

AC GRID

Nominal voltage(a.c.V)	220/230/240
Nominal frequency(Hz)	50/60
Nominal output power(W)	10000
Max. cont. apparent output power(VA)	10000
Max. cont. output current(a.c.A)	43.5
Max. cont. apparent input power(VA)	14490
Max. cont. input current(a.c.A)	63
Power factor	1(-0.8...+0.8 adjustable)

EPS

Nominal voltage(a.c.V)	220/230/240
Nominal frequency(Hz)	50/60
Max. cont. apparent output power(VA)	10000
Max. cont. output current(a.c.A)	43.5

OTHERS

Ingress protection	IP65
Operation temperature range (°C)	-25...+60
Inverter topology	Non-isolated
Over voltage category	III (AC), II (DC)
Protective class	Class I





Jiangsu Weiheng Intelligent Technology Co., Ltd.
 Address: Sheng Xiang, Xuei Community, Luoshe Town, Huaihan District, 214000, Wuxi City, Jiangsu Province
 www.weiheng-tech.com Made in China

HV Box Nameplate:

HBC57I-P 100% DoD Version



Rechargeable Li-ion Battery System

Model/Nominal Voltage/ Energy/Operating Voltage Range	
☐ BXC-4.992kWh-1S-1/96Vdc/4.99kWh/84-108V	Battery Designation IFpP13/122/360[(30S)1P]M/-20+50/95
☐ BXC-4.992kWh-2S-1/192Vdc/9.98kWh/168-216V	Battery Designation IFpP13/122/360[(30S)2P]M/-20+50/95
☐ BXC-4.992kWh-3S-1/288Vdc/14.9kWh/252-324V	Battery Designation IFpP13/122/360[(30S)3P]M/-20+50/95
☐ BXC-4.992kWh-4S-1/384Vdc/19.9kWh/336-432V	Battery Designation IFpP13/122/360[(30S)4P]M/-20+50/95
☐ BXC-4.992kWh-5S-1/480Vdc/24.9kWh/420-540V	Battery Designation IFpP13/122/360[(30S)5P]M/-20+50/95
☐ BXC-4.992kWh-6S-1/576Vdc/29.9kWh/504-648V	Battery Designation IFpP13/122/360[(30S)6P]M/-20+50/95

HV Box Model	HBC57I-P
Capacity	52Ah
Ingress Protection	IP65
Operating Ambient Temperature	-20°C~55°C
Nominal Charge/Discharge Current	26A
Max. Charge/Discharge Current	52A
Protective Class	I



Jiangsu Weiheng Intelligent Technology Co., Ltd.
 Address: Sheng Xiang, Xuei Community, Luoshe Town, Huaihan District, 214000, Wuxi City, Jiangsu Province
 www.whes.com Made in China

Battery Nameplate:

BXC-4.992kWh: 100% DoD Version



Rechargeable Li-ion Battery

IFpP13/122/360[(30S)1P]M/-20+50/95

Rated Capacity:52Ah

Model No./Nominal Voltage/Rated Energy:
 BXC-4.992kWh/96Vdc./4.992kWh

Max.Charge/Discharge Current:52A

Nominal Charge/Discharge Current:26A

Operating voltage range:84V...108V

Operating temperature range:
 0°C...+50°C(Charge)-20°C...+55°C(Discharge)

Available SOC Range:0%...100%

Protective Class:I

Ingress Protection:IP65



The battery should be disposed by qualified recycling agent.

CAUTION

- Do not disassemble the battery pack.
- Do not immerse the battery pack in water.
- Do not short-circuit the battery.
- Do not leave the battery near by fire.

Emergency Situations

*If leaking, fire, wet or damaged, switch off the breaker and go away from the battery.

*Do not touch the leaking liquid. Do not use water. Sand or dry powder extinguisher is usable.



Manufacturer: Jiangsu Weiheng Intelligent Technology Co., Ltd.
Made in China

3.7 Technical Data









Model	SIA-3.6KW	SIA-4.6KW	SIA-5KW	SIA-6KW	SIA-8KW	SIA-10KW
PV Input						
Absolute max Voltage [d.c.V]	600					
MPPT Voltage Range [d.c.V]	50...560					
Max. DC Input Power [W]	7360	9200	10000	12000	16000	20000
Start-up Voltage [d.c.V]	90					
Rated Operating Voltage [d.c.V]	360					
Max. Input Current [d.c.A]	16/16				32/32	
Isc PV[d.c.A]	22/22				44/44	
NO. of MPP Trackers	2				2	
NO. of Strings per MPP Tracker	1/1				2/2	
Battery Model						
Battery Type	LFP					
Battery Voltage Range [d.c.V]	80...600					
Battery Model	4.992kWh, 96V					
Number of Battery Module*	1...4					
Battery Capacity [kWh]	4.99...19.97					
Max. Charge/Discharge Current [d.c.A]	50/50					
AC Input/Output						
Nominal Output Power [W]	3680	4600	5000 (4999 for AU)	6000	8000	10000 (9999 for AU)
Max. Apparent Power to Grid [VA]	3680	4600	5000 (4999 for AU)	6000	8000	10000 (9999 for AU)
Max. Apparent Power from Grid [VA]	7360	9200	10000	12000	14490	14490
Nominal Voltage [a.c.V]	220/230/240					
Nominal Frequency [Hz]	50/60					
Max. AC Current to Grid[a.c.A]	16	20	21.8	26.1	34.8	43.5
Max. AC Current from Grid[a.c.A]	32	40	43.5	52.2	63	63
AC input power factor	-0.8...+0.8					
AC output power factor	1(-0.8...+0.8 adjustable)					
THDi	< 3%					
EPS Output (With Battery)						





Nominal Output Power [W]	3680	4600	5000 (4999 for AU)	6000	8000	10000 (9999 for AU)
Peak Output Apparent Power [VA] @10 sec	5520	6900	7500	9000	12000	14490
Nominal Voltage [a.c.V]	220/230/240					
Nominal Frequency [Hz]	50/60 (±0.2%)					
Max. Output Current [a.c.A]	16	20	21.8	26.1	34.8	43.5
Inrush current[a.c.A]	16 a.c.A (peak), 11.3 us (duration)					
Switch time [ms]	< 10					
THDv @ Linear Load [%]	< 2					
Power Factor	-0.8...+0.8					
Efficiency						
PV Max. Efficiency[%]	98					
PV Europe Efficiency[%]	97					
PV Max. MPPT Efficiency[%]	99.9					
Battery Charge by PV Max. Efficiency[%]	98.5					
Battery Discharge Efficiency[%]	97.7					
Protection						
Over/Under voltage protection	Yes					
DC isolation protection	Yes					
DC injection monitoring	Yes					
Residual current detection	Yes					
Anti-islanding protection	Yes					
Over load protection	Yes					
Battery Input reverse polarity protection	Yes					
PV reverse polarity protection	Yes					
Surge protection	Yes					
Over heat protection	Yes					
General Data						
Dimension (W/D/H)[mm]	600*350*1800(four battery modules, with base)					
Hybrid inverter net weight [kg]	27.4					
Net weight [kg]	30.8					
Operation Temp [°C]	-25...+60					
Relative Humidity[%]	0...95					
Altitude [m]	<= 3000					
Ingress Protection	IP65					
Cooling	Natural					





Inverter Topology	Non-isolated
Over voltage category	III(AC), II(DC)
Protective class	Class I
Active anti-islanding method	frequency shift
Human Interface	LED/APP
BMS Communication Interface	RS485/CAN
Meter Communication Interface	RS485
Noise Emission [dB]	< 25
Standby Power Consumption [W]	< 10

4 INSTALLATION

4.1 Packing List

SIA-3.6kW/ 4.6kW/ 5kW/ 6kW/ 8kW/ 10kW/ 12kW			
			
1 × PCS	Terminal Accessories	Document Accessories	1 × Quick Installation Guide
			
1 × Locking Bracket	1 × Metal Bracket	2 × connection plate	1 × Wi-Fi Module
			
6 × M5*10 screw	4 × φ10*60 Expansion bolt	4 × M4*10 screw	

ALL-IN-ONE High Voltage Box					
					
1 × High Voltage Box 1 × Base	Label Accessories	6 × Sheet Metal Bracket	12 × M4*10 screw	4 × Plastic Handles	

ALL-IN-ONE Battery Box				
				

1 × Battery Box	Label Accessories	4 × M4*10 Screw	2 × Sheet Metal Bracket	4 × Rubber Stoppers
-----------------	----------------------	--------------------	----------------------------	------------------------

4.2 Installation Location and Environment

4.2.1 General

Install the equipment on a surface that is solid enough to bear the product weight. Please evaluate the load-bearing capacity. The installation location should be well ventilated and away from flammable or explosive materials.

The product is rated for outdoor installation and can be installed both indoors and outdoors. The product is naturally ventilated. The installation location must be clean, dry, and adequately ventilated. Enough space should be left for unrestricted access to the unit for installation and maintenance purposes, and the system panels should not be obstructed.

The system should not be installed in the following locations:

- ◆ Habitable rooms;
- ◆ Ceiling or wall cavities;
- ◆ On roofs not suited for the purpose;
- ◆ Access/exit areas or under stairs/access passages;
- ◆ Places where freezing temperatures can occur, such as garages, carports, or other places such as wet rooms;
- ◆ Humid or salty environments;
- ◆ Seismic-prone areas—additional safety measures are needed;
- ◆ Sites higher than 3000 meters above sea level;
- ◆ Explosive atmospheres;
- ◆ In direct sunlight or places susceptible to significant changes in ambient temperature.

4.2.2 Location Restrictions

The system should not be installed:

- (1) Within 600 mm of any heat source, such as hot water units, gas heaters, air conditioning units, or any other similar appliances;
- (2) Within 600 mm of any exit;
- (3) Within 600 mm of any window or ventilation opening;
- (4) Within 900 mm of access to 380/400/415 VAC connections;
- (5) Within 600 mm of the side of any other device.


Leave at least 1 meter of clearance between the system and any emergency exits when installing the device in corridors, lobbies, or hallways to ensure a safe exit.

4.2.3 Barriers to Habitable Rooms

Ensure a suitable non-combustible barrier is set up between the system and any installation walls or structures when installing the system on a wall or structure connected to a living space to protect against the spread of fire to living spaces. A non-combustible barrier should be installed between the system and the surface of the wall or structure it is being mounted to if the surface itself is not made out of a suitable non-combustible material. Increase the distance between the system and any other nearby structures or objects if there is less than 30 mm between the system and the wall or structure separating it from living spaces.

The following spaces around the system must remain empty:

Top -----	500 mm
Bottom -----	500 mm
Front -----	500 mm
Left and right sides-----	500 mm

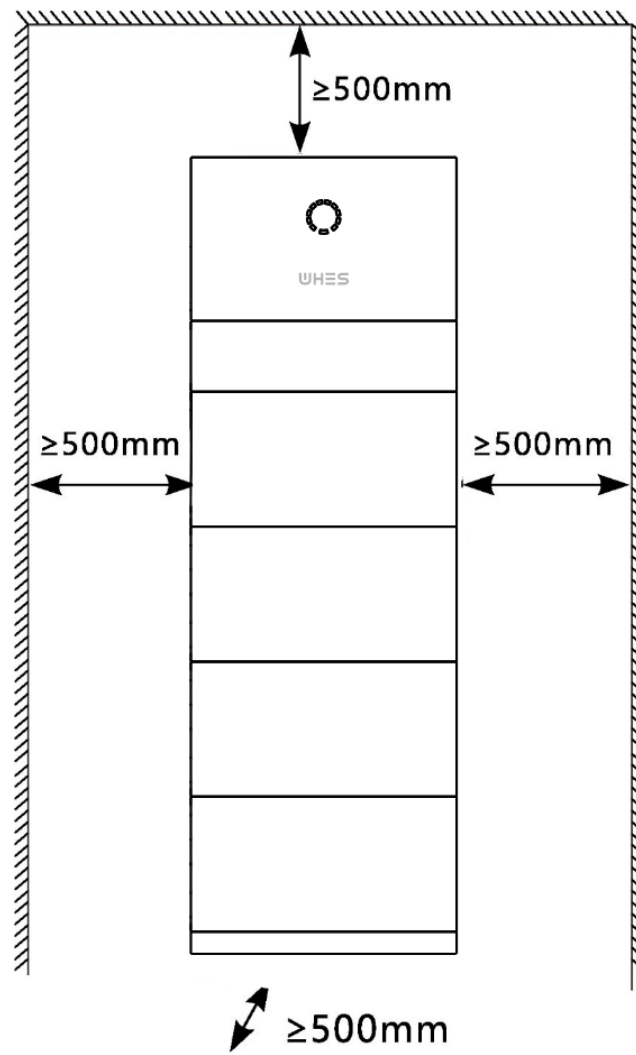


4.2.4 Choosing an Installation Location



Carefully select an appropriate installation location based on the following rules to protect the hybrid inverter and facilitate maintenance.

Rule 1. Do not install the system at forward tilted, back tilted, side tilted, horizontal, or upside down positions.

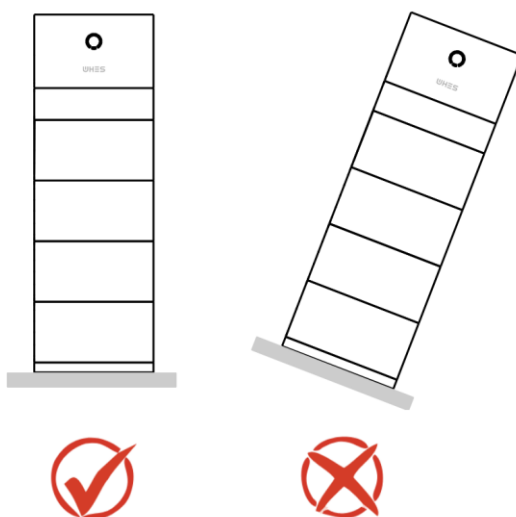


Rule 2. Install the system on a solid brick-concrete structure or concrete wall or floor. If other types of walls and floors are used, they must be made of fire-retardant materials and meet the load-bearing requirements of the equipment.

Rule 3. During installation, ensure that there is no other equipment (except related Weiheng equipment and awnings) or flammable or explosive materials around the system. Reserve sufficient clearances for heat dissipation and safety isolation.

Rule 4. The temperature and humidity at the installation site should be within the appropriate range.

Rule 5. The system installation location should be protected from direct sunlight or bad weather like snow, rain, or lightning.

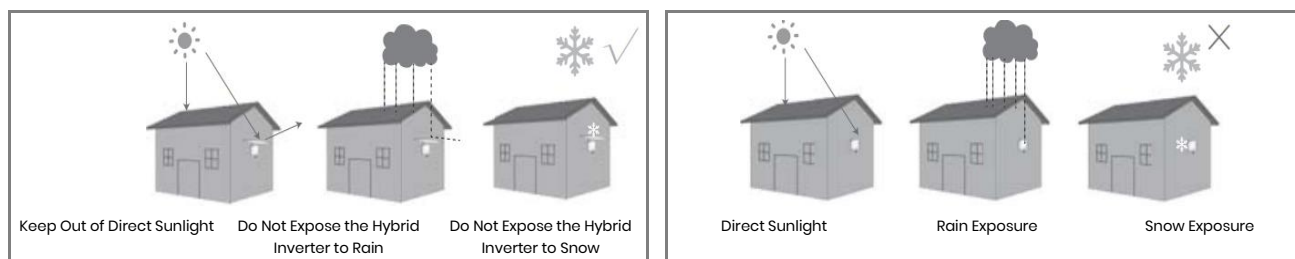

Rule 6. Installing the system at eye level will make maintenance more convenient.

Rule 7. The product label should be clearly visible after installation.

Rule 8. Do not install the system in the snow or rain. If installation in the snow or rain is unavoidable, ensure the system and distribution box are protected and kept dry.

Install the system away from strong magnetic fields to avoid electromagnetic interference. When installing the system next to radio or wireless communication equipment operating below 30 MHz: 1. Install the system at least 30m away from the wireless equipment. 2. Attach a low-pass EMI filter or a multi-winding ferrite core to the system DC input cable or AC output cable.


4.3 Installation Steps



The hybrid inverter must not be installed near flammable or explosive materials or near equipment with strong electromagnetic fields.

The system should only be installed on concrete or other non-combustible surfaces.

Installation Tools:




Screwdriver




Multimeter



Wire stripper




Claw hammer




Hammer drill



Diagonal plier




Insulating gloves



Protective gloves



Crimping pliers





⚠ CAUTION

- Follow local electric safety and installation policy, a suitable breaker between battery system and inverter is required.



- All installation and operation must follow local electric standards and requirements.
- When battery modules are paralleled, the system should be powered off before installation operation.

Step1: Take out the high voltage box and base from the package.

Step2: Place the base on the ground and adjust the height of the bottom support leg with a screwdriver to ensure that the base is horizontal.


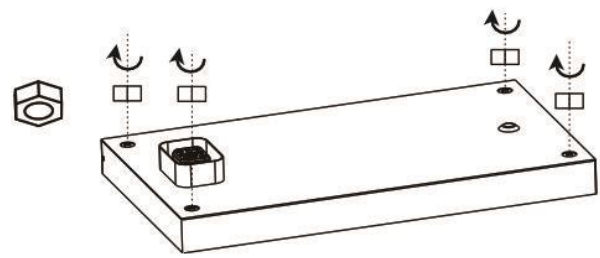
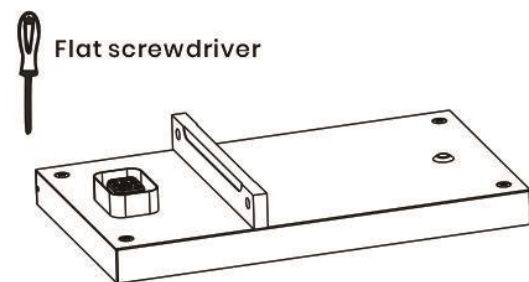


After leveling the base,
the four nuts must be tightened

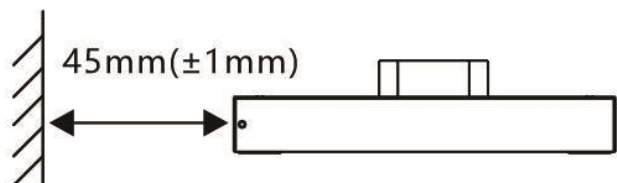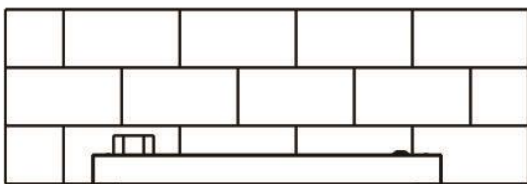

Step3: Install the wall-hanging plate of the high voltage box

Drill a hole with a diameter of 10mm at the center of the waist-type hole in the back plate with the electric drill and place the plastic expansion tube, then fix the self-tapping screw with a screwdriver. The electric drill must with a dust cover to prevent dust from falling off.

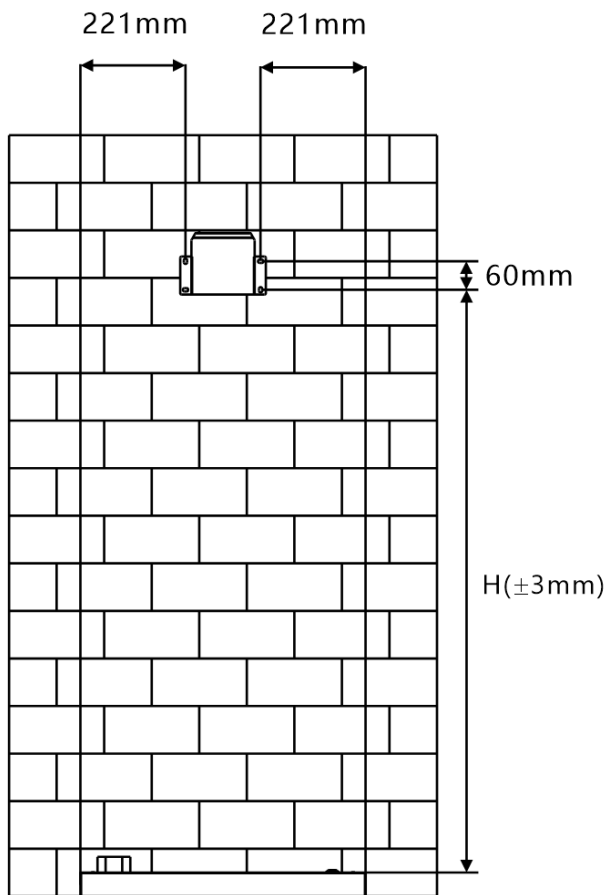


n	H(mm)
2	825
3	1130
4	1435


Step4: Take out the battery box from the package


⚠CAUTION

- Be cautious to prevent injury when moving heavy objects. (The weight of a battery box is 65 kg)
- Use lifting handles to move a battery box. Do not move it directly with your hands.
- Ensure that the lifting handles are securely connected to the battery box, with the steel washers of the lifting handles closely fitted to the battery box. Do not lift the battery box before the lifting handles are tightened.
- The lifting handles are auxiliary moving tools and not applicable to long-distance transportation.
- Do not use a damaged lifting handle. If the stud of a lifting handle is bent, replace the lifting handle promptly.

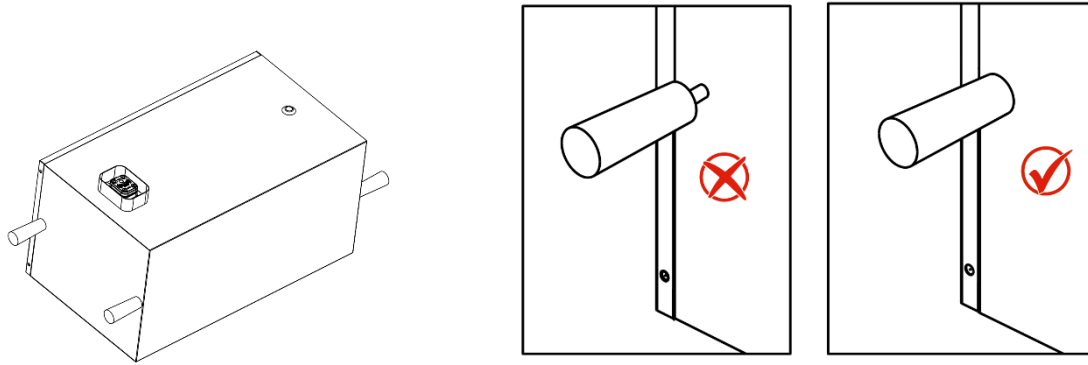


Step5: Install the first battery box, stack the battery on the base. Fix the sheet metal brackets on both sides with screws.

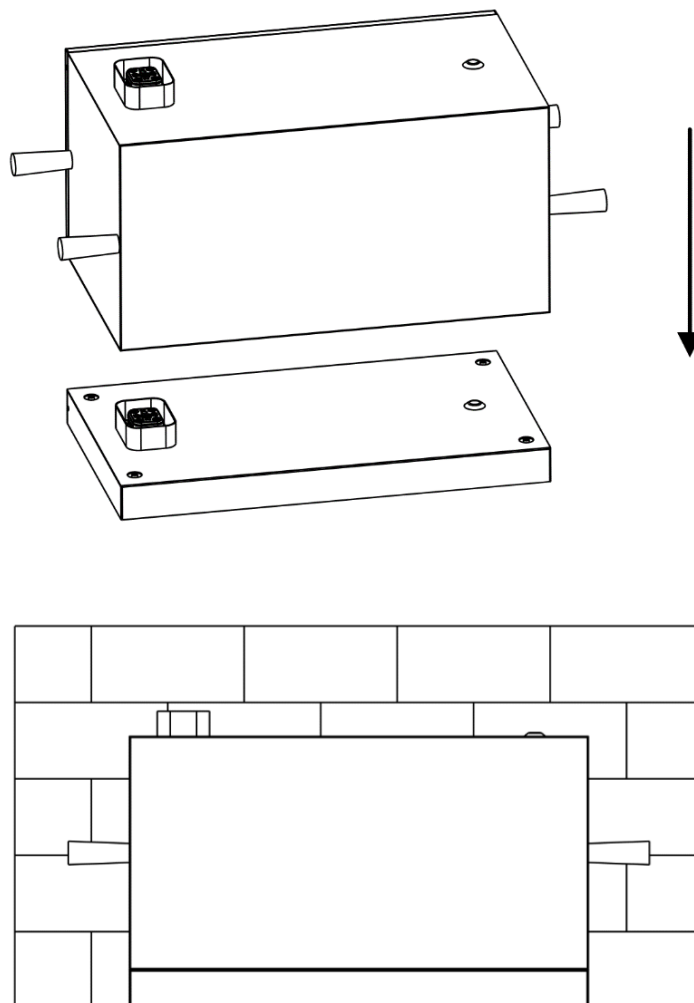

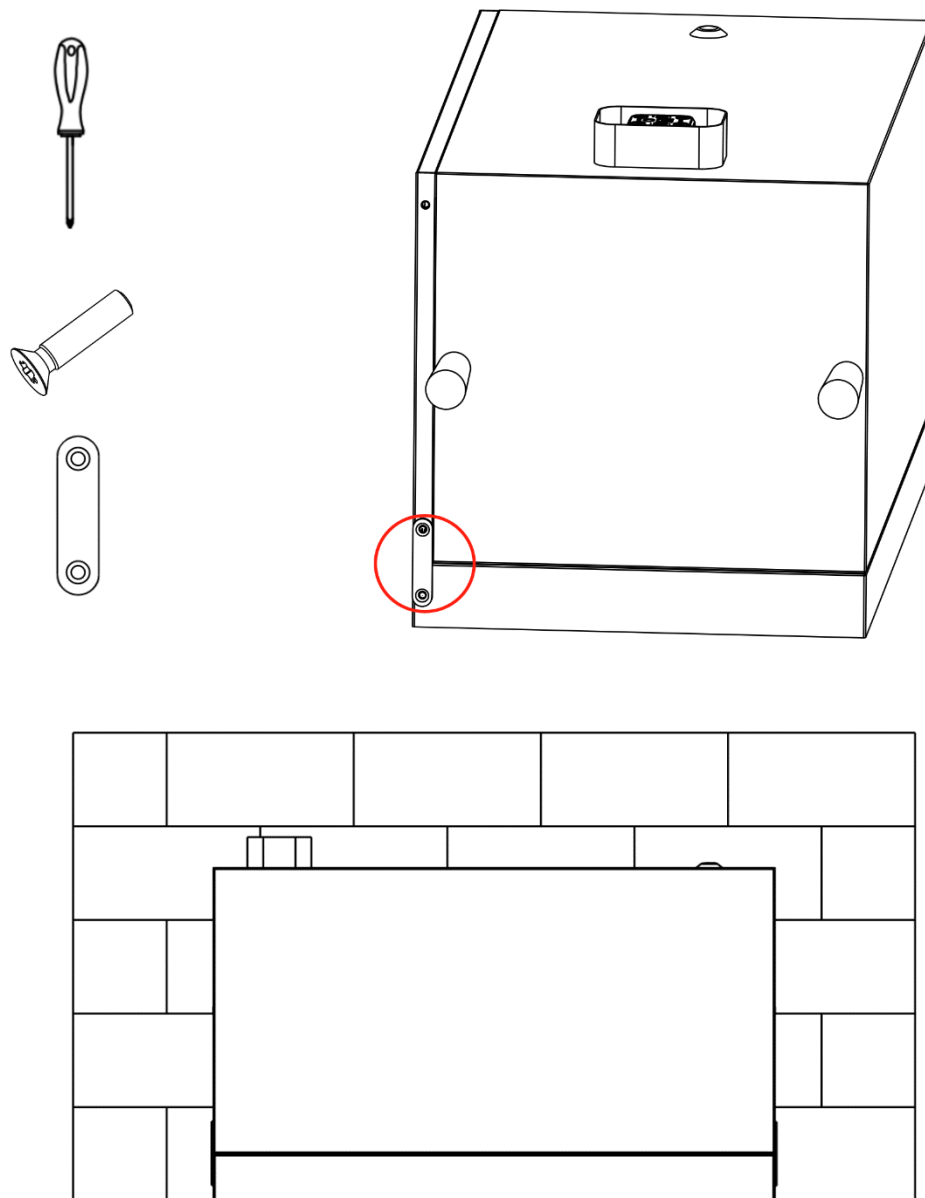

Step6: Install all the battery boxes and high voltage box in turn, fix the connecting pieces on both sides.

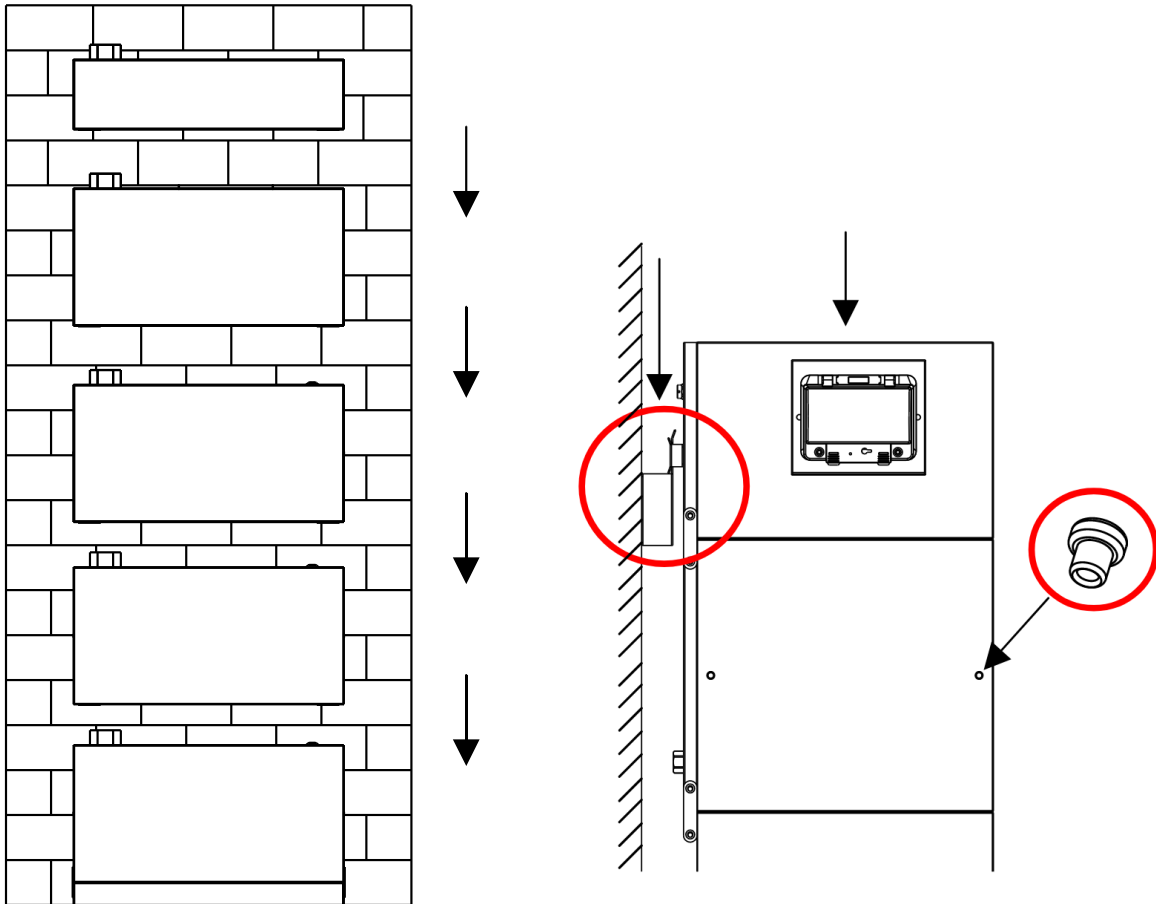**⚠ CAUTION**


- If multiple persons need to move the battery box together, determine the manpower and work division with consideration of height and other conditions to ensure that the weight is equally distributed.
- If two persons or more move the battery box together, ensure that the battery box is lifted and landed simultaneously and moved at a uniform pace under the supervision of one person.
- Wear personal protective gears such as protective gloves and shoes when manually moving the equipment.
- To move the battery box by hand, approach to the battery box, squat down, and then lift the battery box gently and stably by the force of the legs instead of your back. Do not lift it suddenly or turn your body around.
- Do not quickly lift the battery box above your waist. Place the battery box on a workbench that is half-waist high or any other appropriate place, adjust the positions of your palms, and then lift it.
- Move the battery box stably with balanced force at an even and low speed. Put down the battery box stably and slowly to prevent any collision or drop from scratching

the surface of the equipment or damaging the components and cables.



- When moving the battery box, be aware of the workbench, slope, staircase, and slippery places. When moving the battery box through a door, ensure that the door is wide enough to move the battery box and avoid bumping or injury.
- When transferring the battery box, move your feet instead of turning your waist around. When lifting and transferring the battery box, ensure that your feet point to the target direction of movement.

Step7: Take out the inverter from the package.

Step8: Install the metal bracket and connection plate onto the inverter.

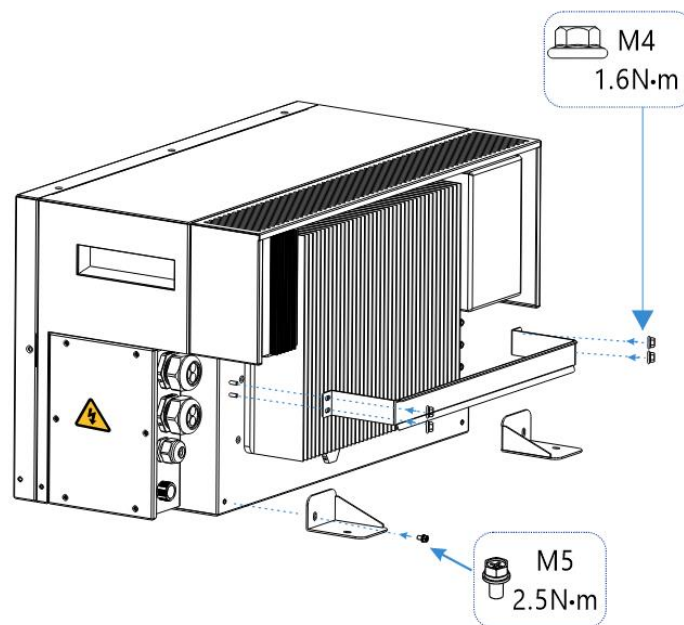



Step9: Install the inverter, put the metal bracket of the inverter into the wall-hanging plate and fix the connection plates on both sides.

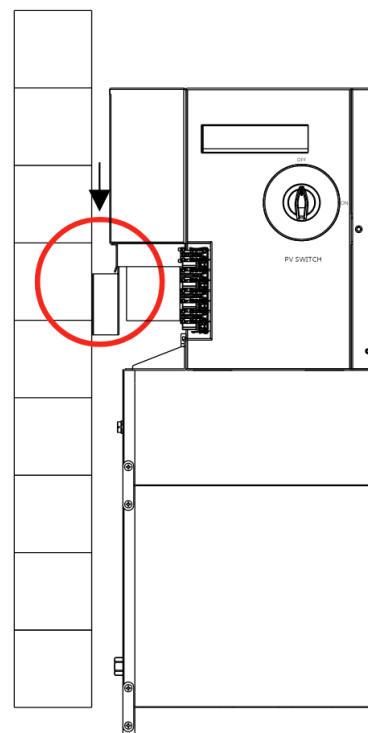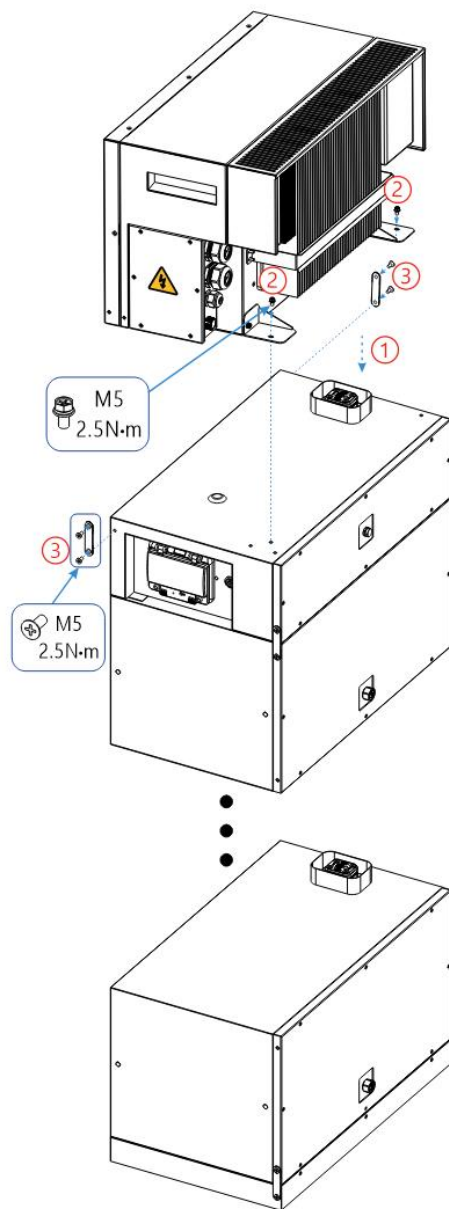

4.4 Cable Connections


4.4.1 General

Make sure all switches and breakers are in the OFF position.

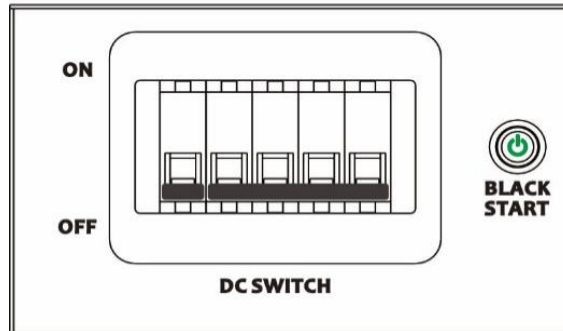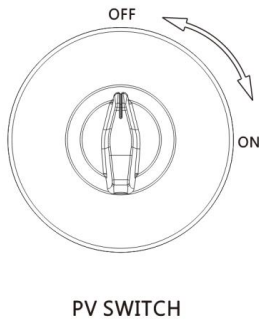

4.4.2 Connect the Inverter Box and Battery Box

System Wiring Diagram

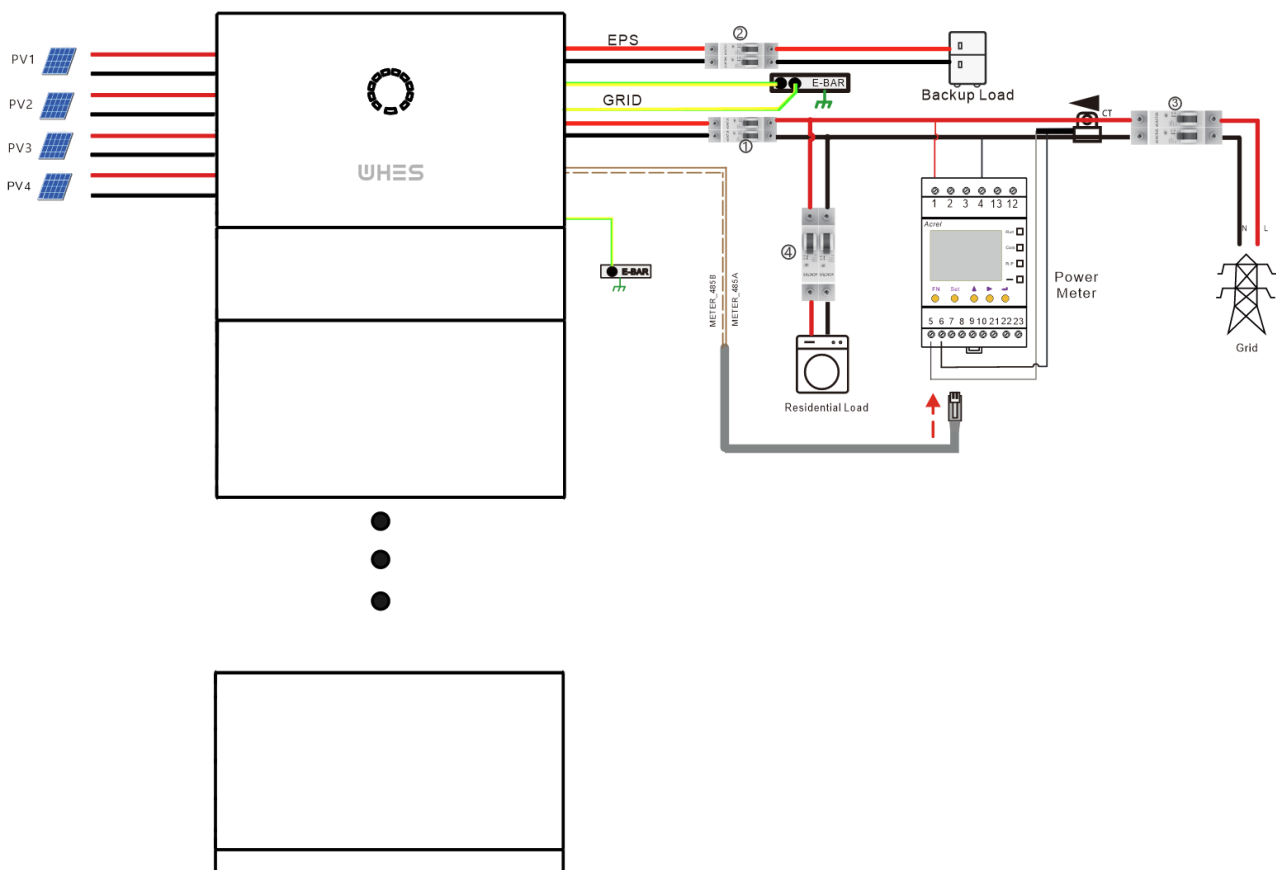

Please use an appropriate breaker based on the following specifications:

NOTICE

- Electrical short circuits on the grid side will damage the inverter if an AC breaker is

not installed.

- This diagram illustrates the wiring diagram for Agave series hybrid inverters, not the electrical wiring standards.
- Please make sure that the AC line matches the "L", "N", and the grounding port of the AC terminal completely when wiring. If the cable is connected incorrectly, the device may be damaged.

Choose the correct breaker:

Model	①	②	③ ④
SIA-3.6kW Series	32 A/230 V AC breaker	20 A/230 V AC breaker	According to residential load (generally already installed in the grid distribution box)
SIA-4.6kW Series	40 A/230 V AC breaker	20 A/230 V AC breaker	
SIA-5kW Series	50 A/230 V AC breaker	25 A/230 V AC breaker	
SIA-6kW Series	63 A/230 V AC breaker	32 A/230 V AC breaker	
SIA-8kW Series	63 A/230 V AC breaker	40 A/230 V AC breaker	
SIA-10kW Series	63 A/230 V AC breaker	50 A/230 V AC breaker	

Recommended cables and connectors:

Cable Type	Cable Specification	Terminal Model
PE Cable	10 AWG	OT5-5 (Included in the accessory packet)
PV+ Cable	10 AWG (RED)	Positive DC Connector (Included in the accessory packet)
PV- Cable	10 AWG (BLACK)	Negative DC Connector (Included in the accessory packet)
Grid Cable	6 AWG	SV5-5.5 (Included in the accessory packet)
EPS Cable	6 AWG	SV5-5.5 (Included in the accessory packet)
Communication Cable	20 AWG	


Connect the ground cable, power cable and communication cable, connection process is as below:

Step 1: Open the waterproof cover panel for junction box of user power cable


⚠ CAUTION

- Make sure all switches and breakers turned OFF !

- The product operates at high voltage. All work on the product must be carried out by qualified persons only.

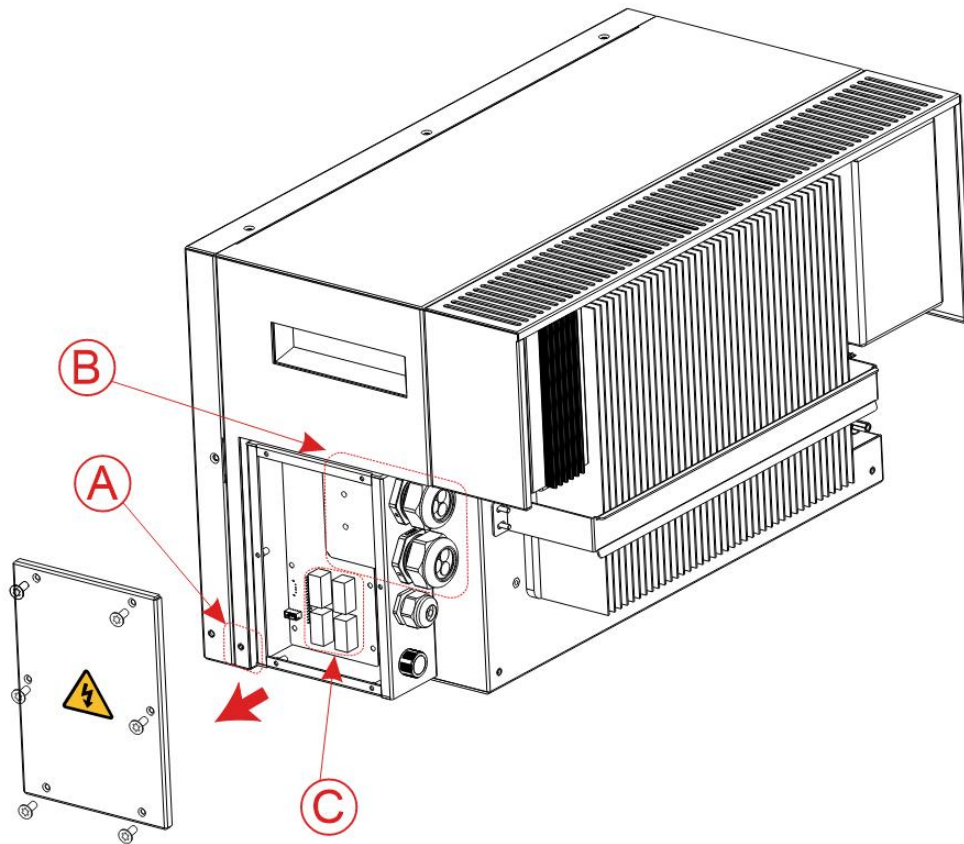

Step 2: Connect the PE cable. (A)

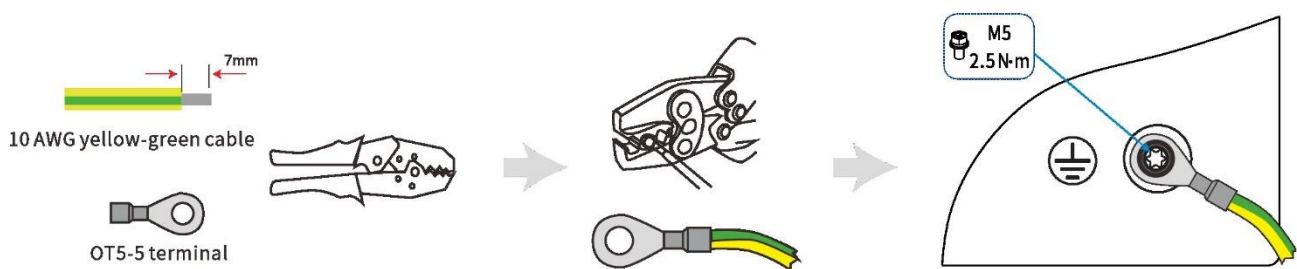

Step 3: GRID and EPS cables (B)

NOTICE


- An AC breaker should be installed between the inverter and grid. Select the appropriate AC breaker in compliance with local laws and regulations. This will ensure the inverter can be securely disconnected during maintenance and fully protected from over current.
- There are three terminal blocks with "GRID" "EPS" and "GEN" markings. Please do not misconnect input and output connectors.

- Note: The diameter of power cable should be less than 6mm.

⚠ WARNING

- Any load should not be connected with the inverter directly.


1、 Loosen the waterproof connector's press nut and remove the seal. Then, insert the cable into the hole.

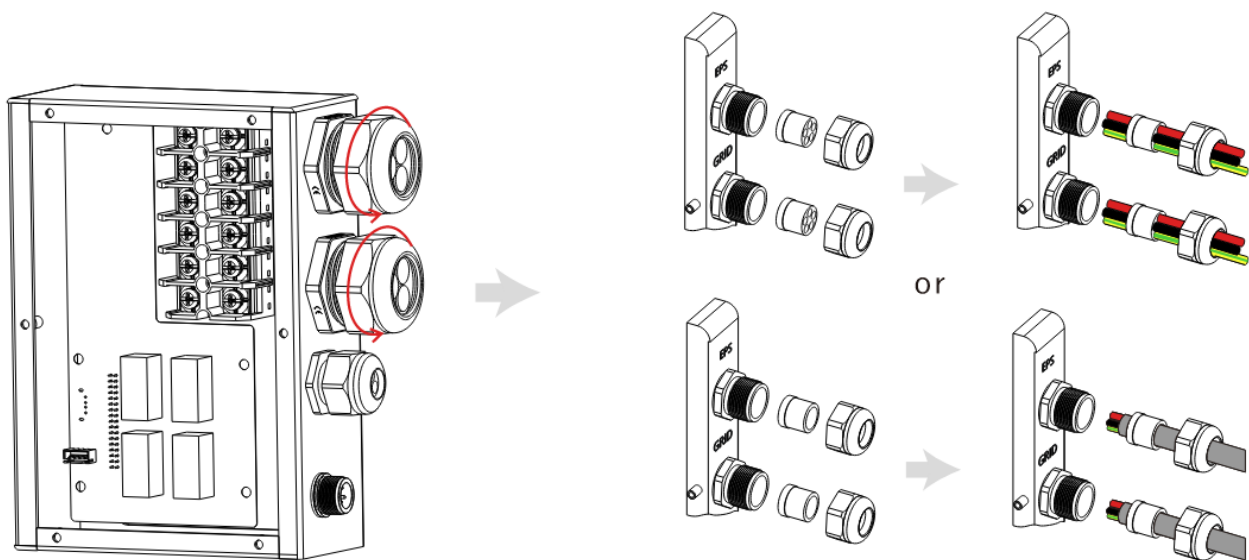


2、 Peel off a 7 mm length of the L/N/PE cable end. Place the SV5-5.5 terminal onto the cable and crimp it tightly using pressure line clamps.




3、 Insert the terminal into the wiring seat, use a Phillips head screwdriver to tighten the screws (2.5 N.m), and tighten the nut.

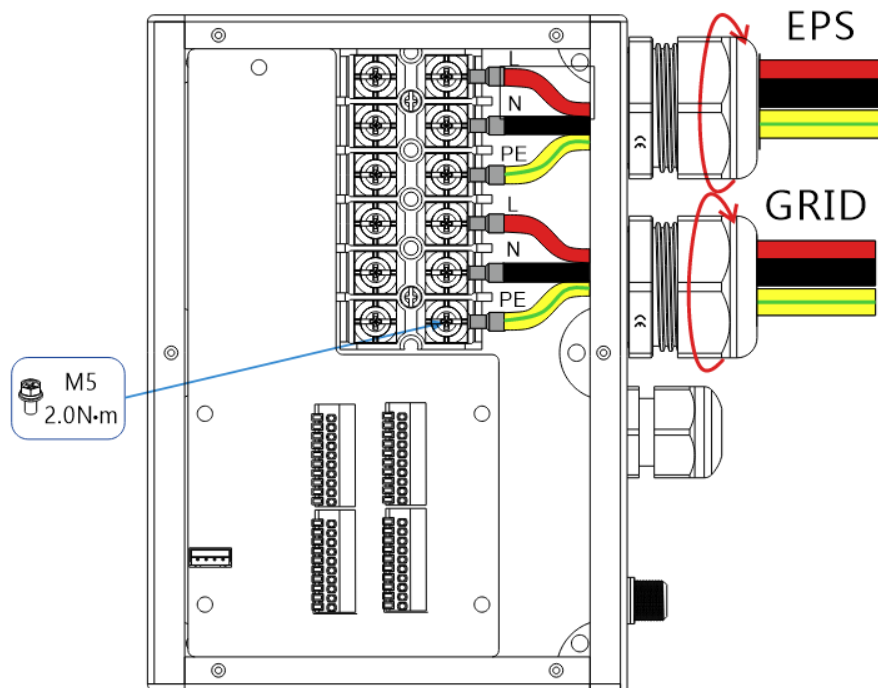**Step 4:** Connecting the communication cables (C)

1、 Loosen the waterproof connector's press nut and remove the seal. Then, insert the cable into the hole.

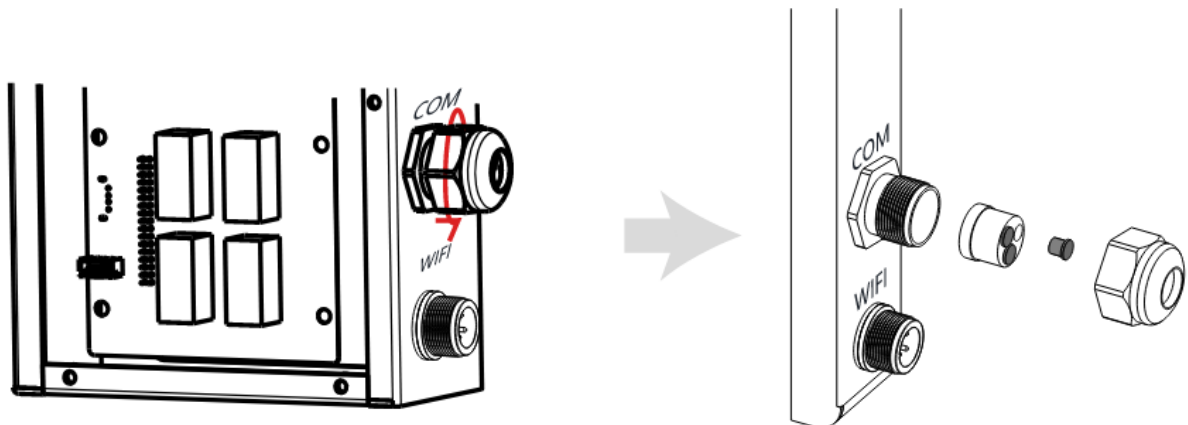



2、 insert the cable into the hole. Peel off a 11 mm length of the Communication cable end.

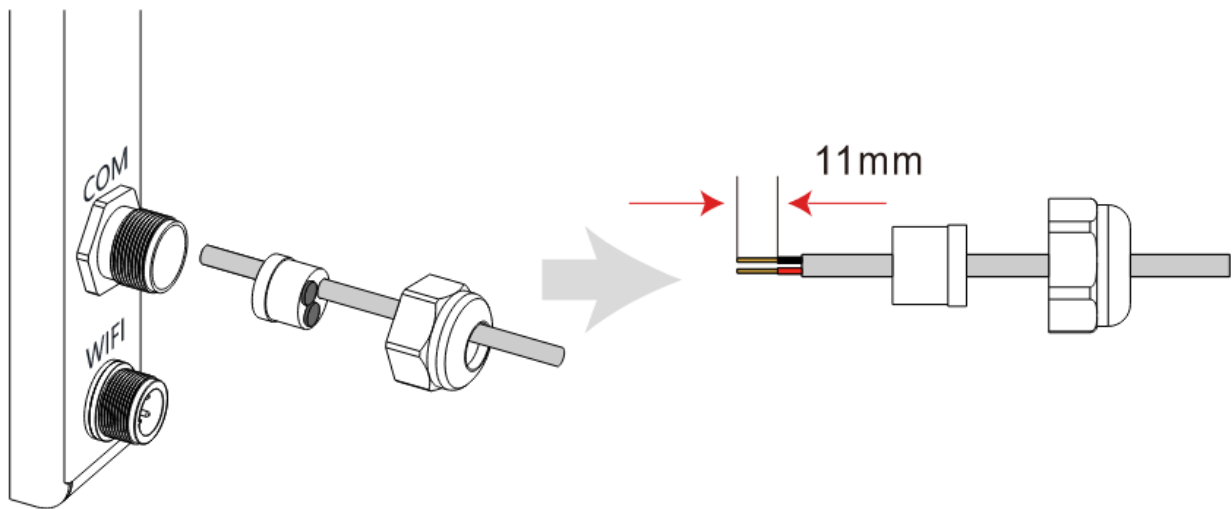**NOTICE**


- Note: The diameter of our network cable harness should be less than 6mm.

3、Insert the terminal into the wiring seat, and tighten the nut.

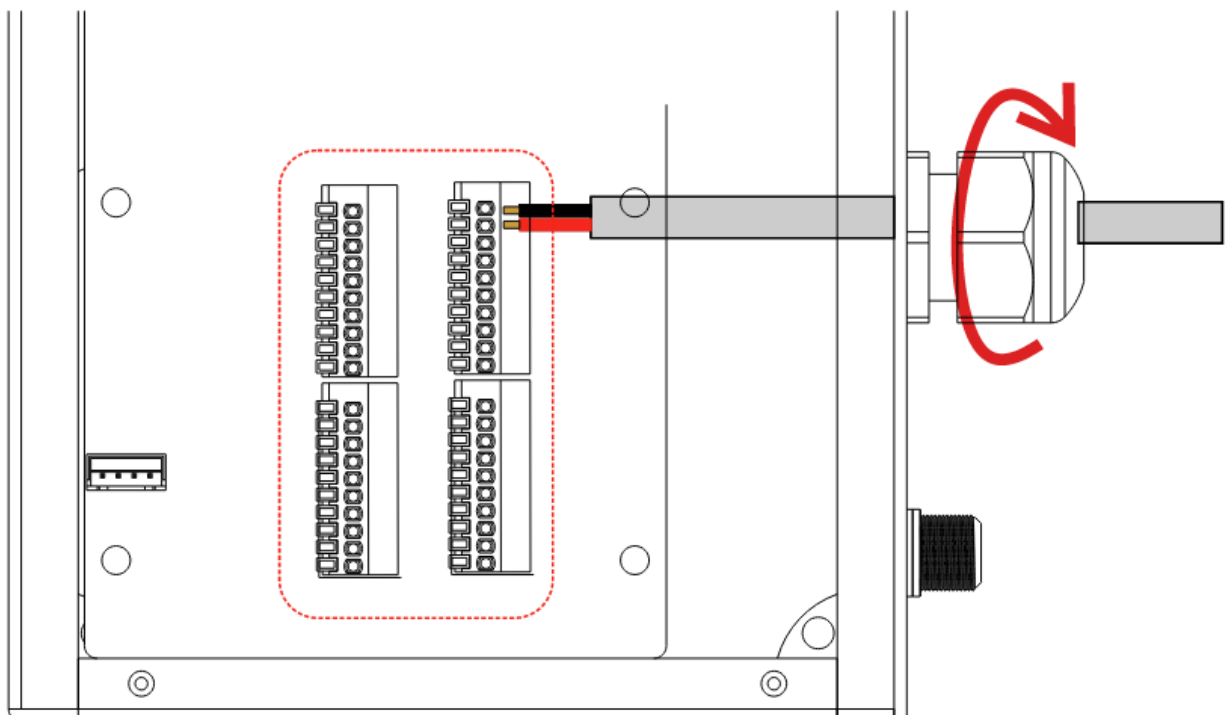

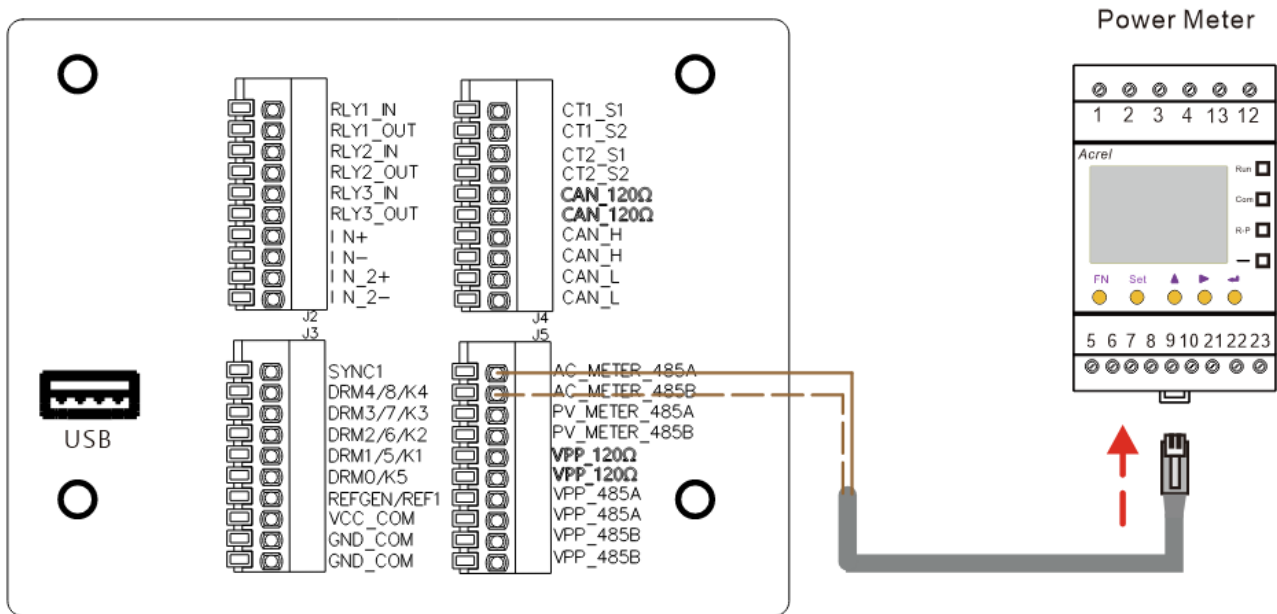

Step 5: Insert the Wi-Fi Module, and tighten the nut. Attach the waterproof cover and lock it in place.

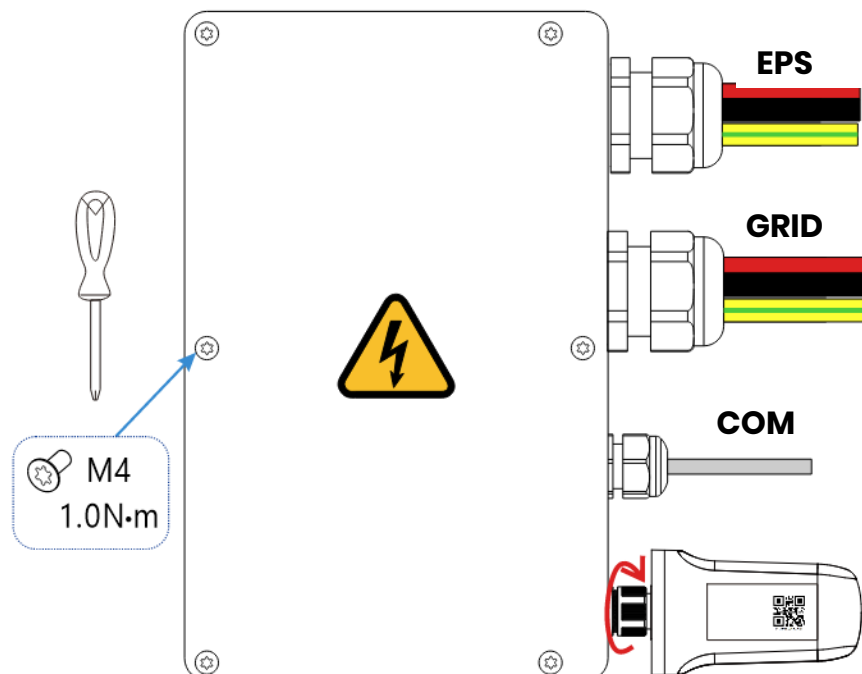

Step 6: Connect the PV cables.


⚠ WARNING

- PV module voltage is very high and within a dangerous voltage range, please comply with the electric safety rules when connecting;
- Make sure that the max short circuit current and the max input voltage per MPPT are within the permissible range;
- Please make sure to disconnect all the DC and AC switches before any electrical connections. Do not work with power on. Otherwise, an electric shock may occur;
- Please do not make PV positive or negative to ground. Make sure that the positive pole of the PV string connects to the PV+ of the inverter. And the negative pole of the PV string connects to the PV- of the inverter;
- Ensure that the cables are connected securely. Otherwise it will cause damage to the inverter due to overheat during its operation.

NOTICE


- To save cable and reduce DC loss, please install the inverter as near to the PV modules as possible.

1. Crimp the terminal;

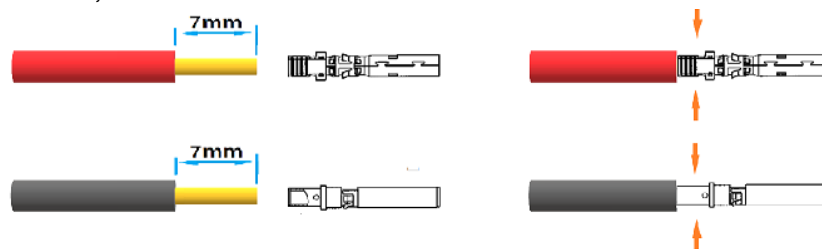


Legend	Description	Value
A	Outer Diameter	5.5–8.0 mm
B	Insulated Cable Length	7 mm
C	Conductor Core	10 AWG

2. Insert the terminal into the connector and lock the nut;

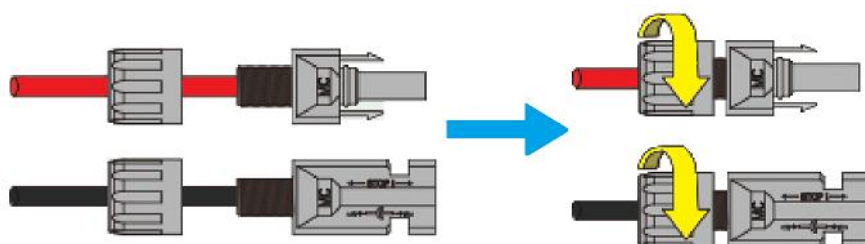

3. Complete the connection.

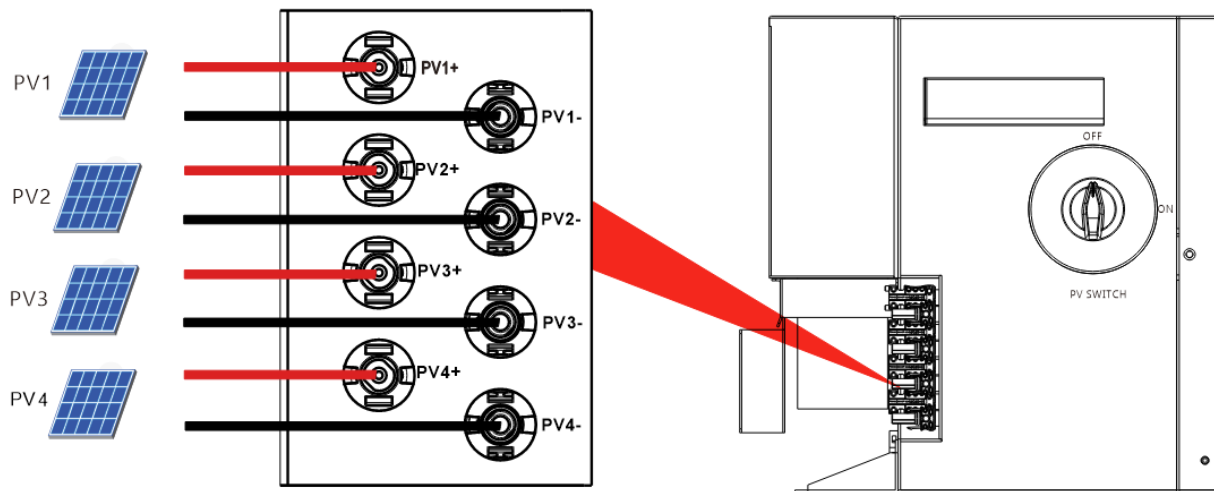


⚠ CAUTION


- 3.6/4.6/5/6kW models have two MPPTs, two strings. Please use PV1 and PV 3.
- 8/10kW models have two MPPTs, four strings. For the best use of PV power, PV1 and PV2, PV3 and PV4 should be the same in PV string structure, including the type, number, tilt, and orientation of the PV modules.
- Pay attention to PV string polarity, and do not connect them in reverse order. Otherwise, the inverter might be damaged.

4.4.3 System Connection Diagrams

The following diagram illustrates an example use case where the neutral wire is separate from the PE in the distribution box. Please follow local wiring regulations.

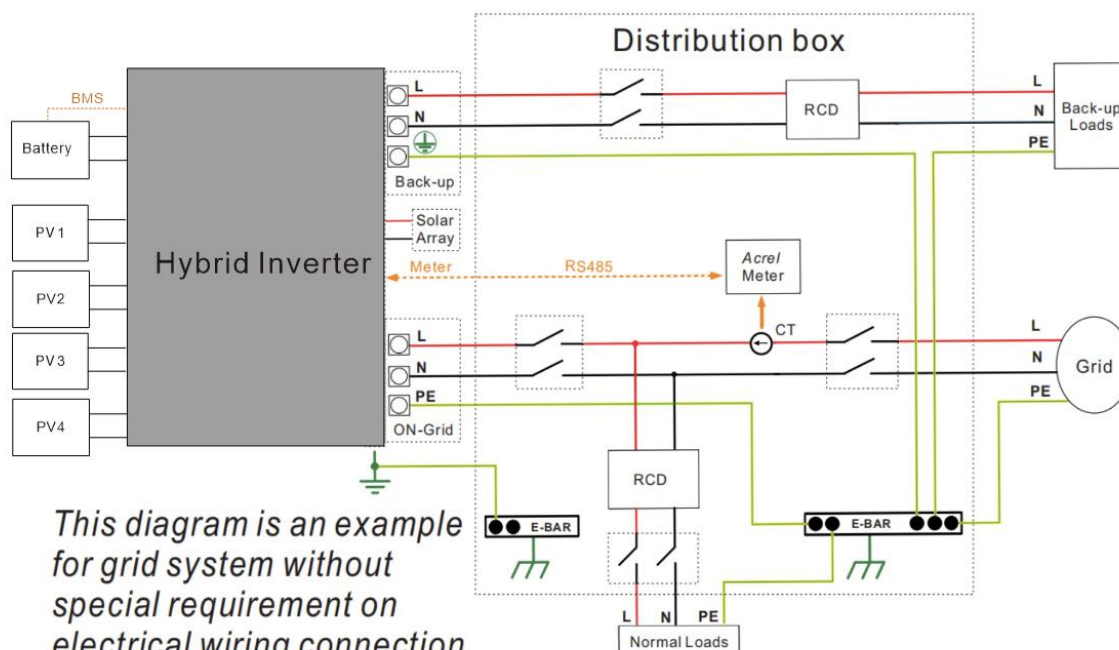

Note: Under Australian safety standards, the On-Grid and Back-Up neutral wires must be connected together, or the Back-Up function will not work.

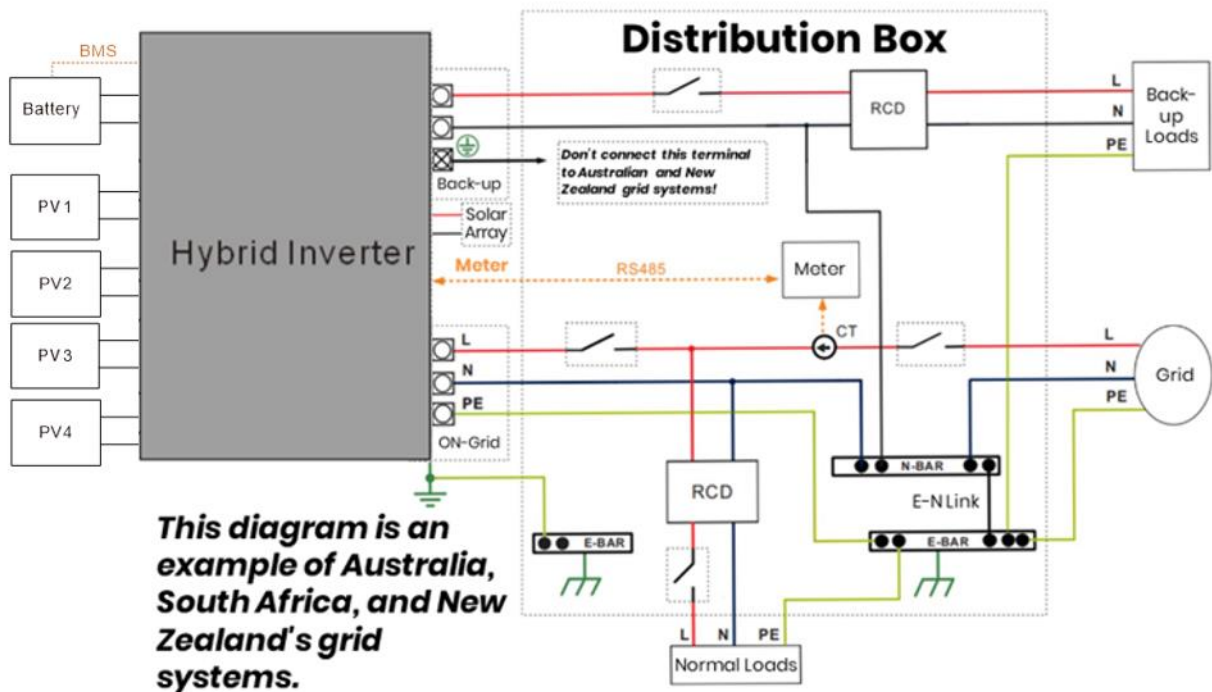


5 System Operation


5.1 Turning on the system

Warning: Please double-check the installation before turning on the system.

Step 1: Open the battery breaker cover and turn the battery breaker to the ON position.

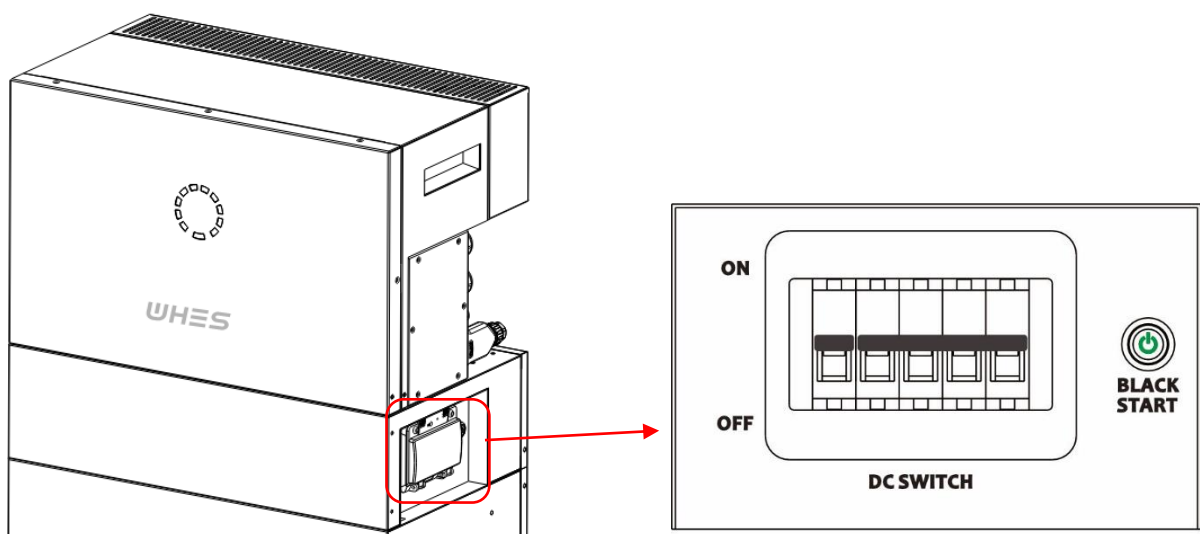

Step 2: Turn on the PV switch.

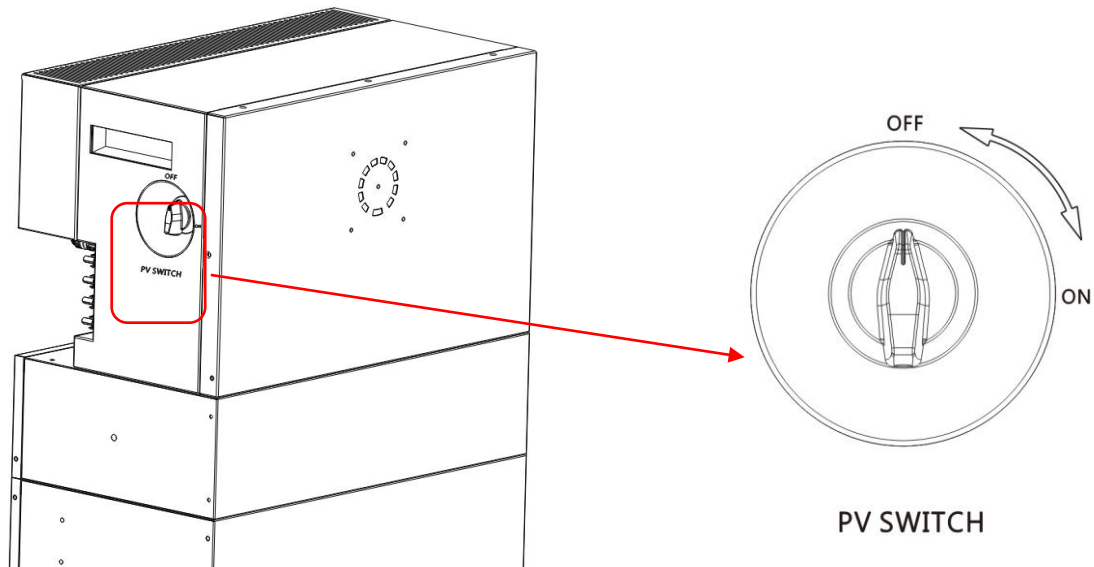

Note: The external isolation devices for PV array ports shall include the requirement of an additional external break switching device that conforms to the requirements AS/NZS 4777.1

Step 3: Turn on the grid breaker.

Step 4: Turn on the backup breaker if a backup load is being used.

Step 5: Close the battery breaker cover.

Step 6: Configure the Wi-Fi dongle (Only when turning on the system for the first time).

5.2 Turning off the system

Step 1: Disconnect the backup load where applicable and then turn off the backup breaker.

Step 2: Turn off the grid breaker.

Step 3: Turn off the PV switch.

Step 4: Open the battery breaker cover and turn the battery breaker to the OFF position.



Step 5: Close the battery breaker cover.

6 ECOS CONFIGURATION & WI-FI RELOAD

This part demonstrates the ECOS configuration step by step.

6.1 Preparations

1. A router connected to the Internet is required to connect to the ECOS application center.
2. Android or iOS smartphone.

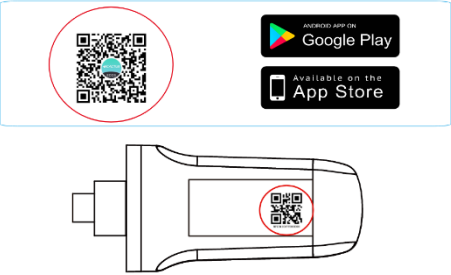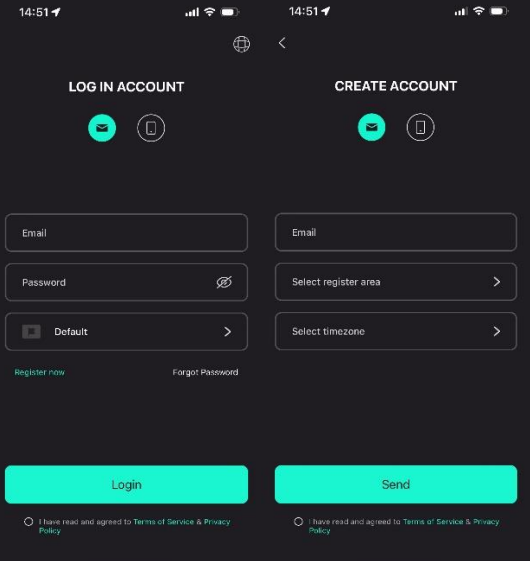STEP 1 1. Scan the QR code on the front of the device to install the Android or iOS version of the ECOS app, depending on your operating system.	 The diagram illustrates the first step of the preparation process. It shows a QR code on the front of the device, which is circled in red. To the right of the QR code are two buttons: 'Google Play' and 'Available on the App Store'. Below these elements is a line drawing of the device, also with a QR code on its front, circled in red.
STEP 2 1. Open the ECOS app and tap the sign-up button to register a new user account. 2. Follow all the instructions given during the sign-up process to successfully connect the device to ECOS. 3. The product ID QR code required for connection can be found on the included Wi-Fi dongle installed on the right side of the device.	 The screenshot shows the ECOS app interface on a smartphone. At the top, there are two tabs: 'LOG IN ACCOUNT' and 'CREATE ACCOUNT'. Below the 'LOG IN ACCOUNT' tab, there are input fields for 'Email' and 'Password', a 'Default' button, and a 'Register now' link. Below the 'CREATE ACCOUNT' tab, there are input fields for 'Email', 'Select register area', and 'Select timezone', and a 'Send' button. At the bottom, there are two checkboxes: 'I have read and agreed to Terms of Service & Privacy Policy'.

NOTICE

- Please ensure the correct router password is entered.
- Make sure that the Wi-Fi dongle's wireless network connection is strong.
- If everything is set up properly, the Wi-Fi LED on the inverter will change from slowly flashing to quick flashing and then become solid, indicating that eCactus has successfully connected to the Wi-Fi network.

6.2 Wi-Fi Reset & Restore

Wi-Fi Reset: Reconfigure the Wi-Fi dongle, and Wi-Fi settings will be reprocessed and saved.

Wi-Fi Restore: Restore the Wi-Fi dongle settings back to the default factory settings.



Wi-Fi Reset:

Please use your ECOS app to reset the Wi-Fi configuration.

Navigate to Settings and My Devices, access the Wi-Fi Configuration page, and follow the instructions to complete the Wi-Fi process.

Wi-Fi Restore:


You also need to configure Wi-Fi network after set Wi-Fi dongle back to factory setting.

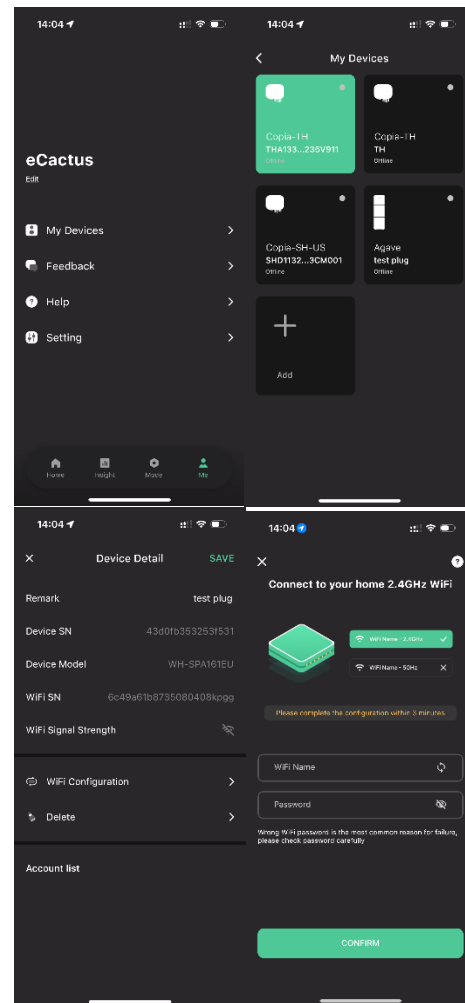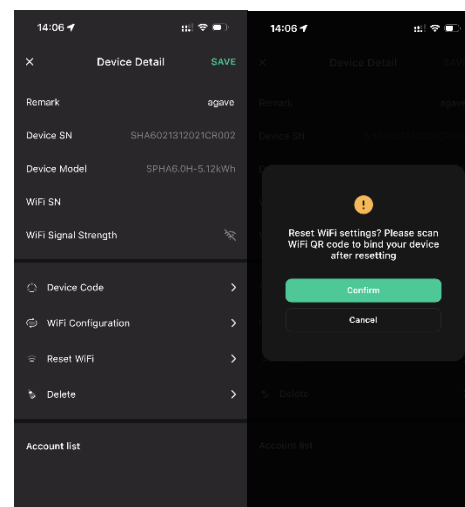Wi-Fi Reset:**Wi-Fi Restore:**


6.3 Change Password & Delete Account

Change Password


You can change your password by navigating to “**Settings**” >> “**Security**” >> “**Change Password**” and entering your Original Password to set a new password.

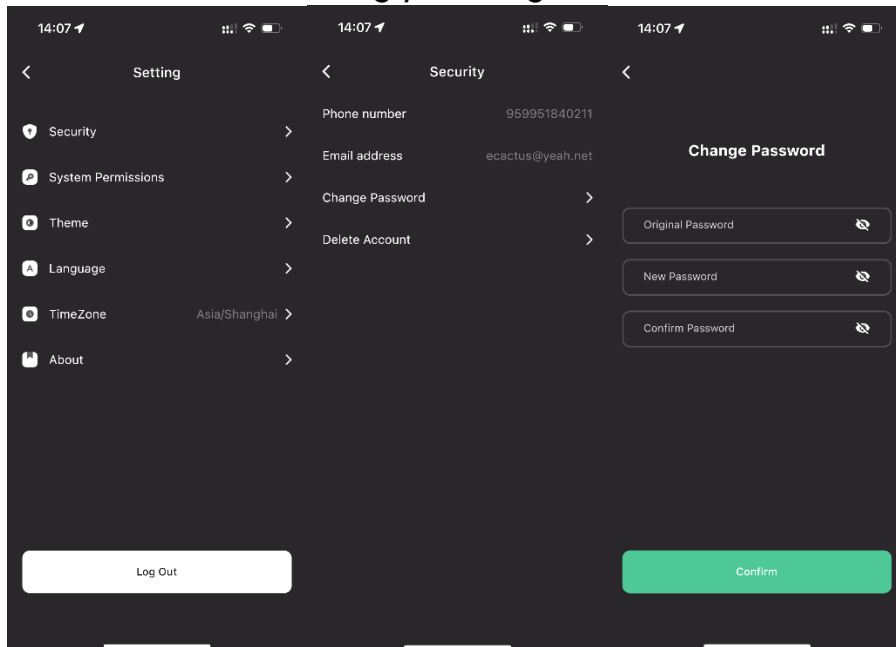

If you forget your password, you can reset your password by tapping “**Forgot Password**” on the login page and entering the verification code sent to your email address.

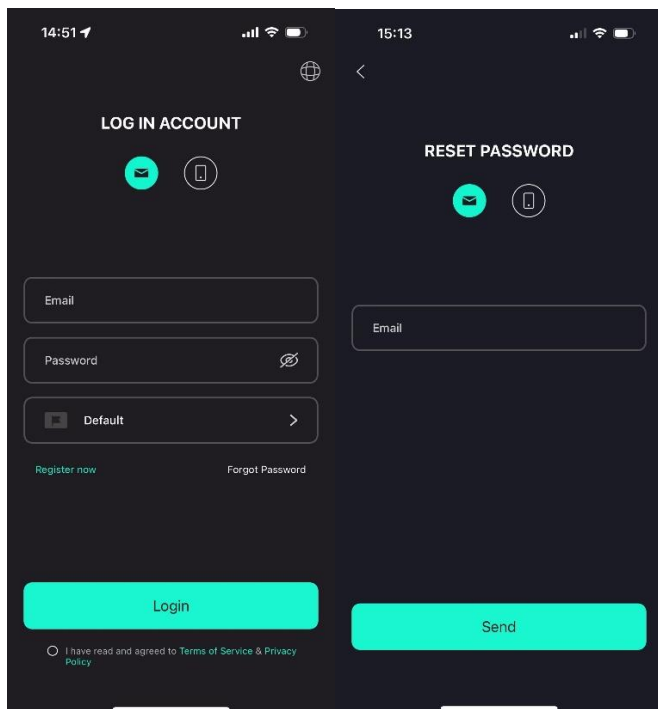

Delete Account

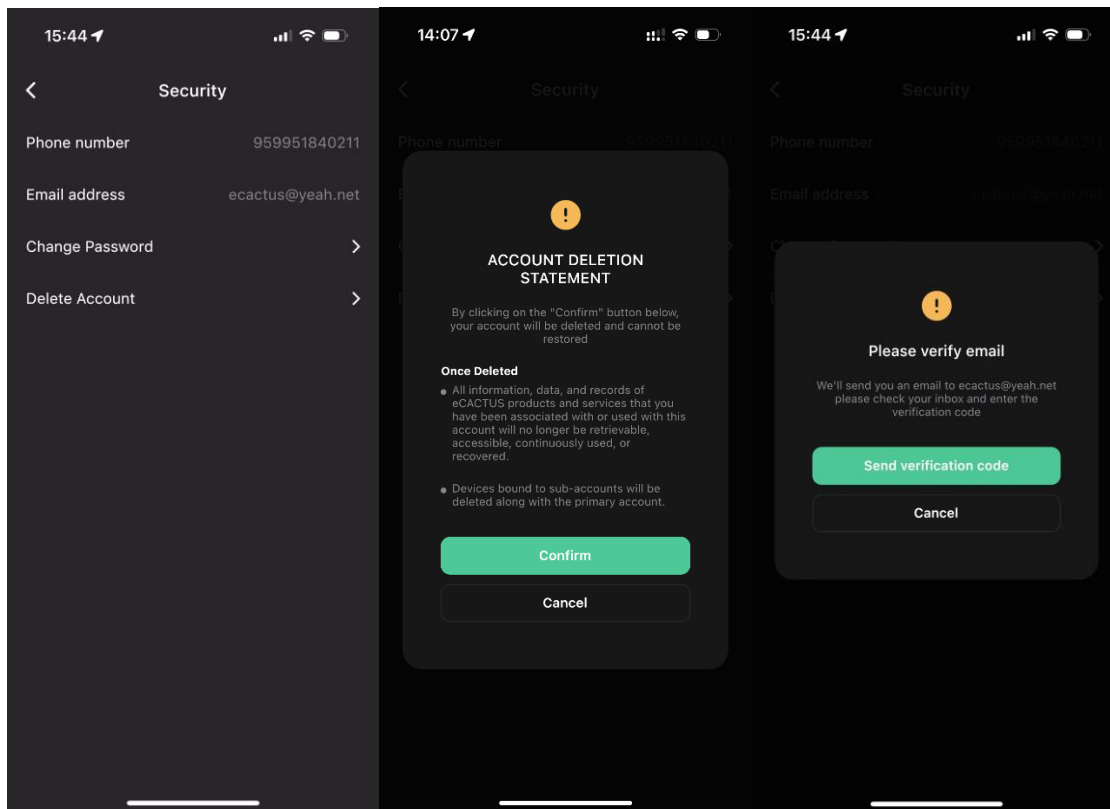

You can delete your account and data by navigating to “**Settings**” >> “**Security**”>> “**Delete Account.**” Please read the statement carefully before deleting your account.

Notice: You have 7 days to log back in and cancel your deletion request. Once deleted, your account and all associated data will be erased and cannot be recovered. When complete, we will send an email to your ECOS account to inform you that your account has been successfully deleted.

7 EMS CONFIGURATIONS

Energy management system (EMS) configurations can be set via the eCactus ECOS app or online website.

Three working modes can be configured:

1. Self-Powered:

eCactus will manage residential power to minimize power grid reliance.

2. Load Shifting:


Batteries will be charged and discharged as configured.

3. Backup:

eCactus will not discharge the battery unless the power grid is off. When this happens, eCactus will provide residential power through the batteries.

Working Modes:

Navigate to the Customize tab and select one of the three operation modes via the eCactus ECOS app.

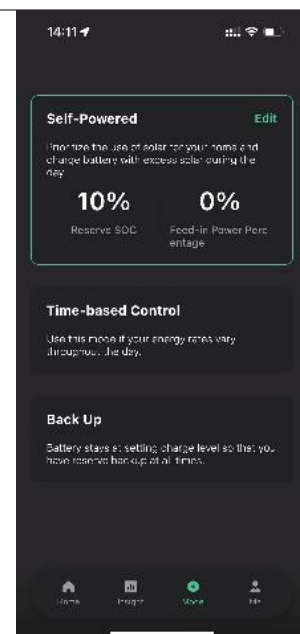

8 TROUBLESHOOTING

	Issue	Solution
1	Red LED flashing every 0.5 seconds	Meter Communication Fault. Please check whether the power supply & communication cables are properly connected in accordance with local standards.
2	Red LED flashing every 2 second	Battery Communication Fault. Please check whether the PCS is properly connected to the battery box, and make sure that the battery switch and breaker are both in the ON position.
3	Abnormal ECOS Energy Flow Monitoring	Please check whether the power supply and CT have been properly installed according to the installation manual.
4	All the LEDs are off	Please check whether the voltage at each port is within the normal range.
5	SOC mis-indicates and fluctuates after initial installation	Do nothing, and the device will self-correct itself as soon as the battery is fully charged or discharged.
6	Battery completely depleted	We highly recommend disconnecting the battery ASAP during installation or when the device is on standby to avoid serious depletion and damage caused by extreme power consumption over a long period of time. Please contact after-sale services for technical support in the event of serious battery depletion.
7	Code DSP_1	PV1 overvoltage. Please check whether the open circuit voltage is within the normal voltage range.
8	Code DSP_2	PV1 overcurrent. Please check whether PV1 is correctly connected.
9	Code DSP_3	PV2 overvoltage. Please check whether PV2 is within the rated voltage range.
10	Code DSP_4	PV2 overcurrent. Please check whether PV1 is correctly connected.
11	Code DSP_9	Please check whether PV is within the normal voltage range.
12	Code DSP_10	No grid power. Please check whether the grid

	Issue	Solution
		voltage is normal.
13	Code DSP_11	Grid voltage fault. Please check whether the grid voltage is within the normal range.
14	Code DSP_12	Grid current fault. Please check whether the EPS load power is within the normal range.
15	Code DSP_13	Grid frequency fault. Please check whether the grid frequency is within the normal range.
16	Code DSP_14	Overheat fault. Please check whether the cooling system is working properly.
17	Code DSP_16	Current over-leak fault. Please check the solar panel and device wiring.
18	Code DSP_17	Isolation resistance fault. Please check the solar panels and wiring system.
19	Code DSP_26	Battery voltage fault. Please check whether the battery voltage is within the normal range.
20	Code DSP_37	EPS voltage fault. Please check whether the EPS load power is within the normal range.
21	Code DSP_38	EPS current fault. Please check whether the EPS load power is within the normal range.
22	Code DSP_39	EPS overload fault. Please check whether the EPS load power is within the normal range.
23	Code DSP_40	EPS short circuit fault. Please check whether the EPS load power is within the normal range.
24	Code DSP_41	Earth & Neutral wire fault. Please check whether the earth and neutral wires are properly wired in line with standard requirements.
25	What should I do if I forget my ECOS password?	Please visit the ECOS website or use the app, tap "Forgot Password," enter your email address for verification, and follow the instructions to reset your password.
26	How can I change my ECOS password?	Log into ECOS and navigate to "Settings" >> "Security" >> "Change Password" to enter your new password.
27	How can I delete my device account?	Log into ECOS, then navigate to "Security" >> "Delete Account." Complete email verification to request Account Deletion. Deletion requests can

	Issue	Solution
		be canceled by logging in within 7 days after requesting account deletion. All account data will be deleted and will not be recoverable. Please think twice before deleting your account.
28	How can I share my ECOS account with my family members?	The first ECOS registered will be recognized as the master account, and others can scan the device code shared by the master account. Please navigate to "Settings" >> "My Device" >> "Device code" to share the code.
29	Why is there no data on the home page?	The device may be offline. 1- Check whether your Wi-Fi is working; 2- Check whether the LED is on; 3- Check whether the Wi-Fi dongle is properly connected; Data may take a while to upload, after which ECOS will be bound to the device. Poor mobile phone reception. Check whether the internet is working properly and try to restart ECOS.
30	Adding multiple devices to ECOS	Log in to the ECOS app and tap the "+" on the top left of the home page. Scan the QR code on the Wi-Fi dongle to add new devices. Or navigate to "Setting" >> "Devices" and tap the "+" to add more devices.
31	How can I delete my device account?	Log in to ECOS and navigate to "Setting" >> "My Devices," select the device account, and tap the top right of the screen to delete the device.
32	Why is the device offline	There are many possible reasons for the device to be offline. 1. Check whether the Wi-Fi network is working properly 2. Check whether the LED is on 3. Check whether the LED on the Wi-Fi dongle is on
33	Why can't I search for and find the Wi-Fi dongle hotspot?	1. Check whether the LED is on 2. Check whether the LED on the Wi-Fi dongle is on

	Issue	Solution
		3. Restart or reconnect the Wi-Fi dongle
34	Why is no internet connection found when returning to other interfaces after configuring ECOS via WLAN?	Disconnect your mobile phone from the WLAN, and reconnect it to your home Wi-Fi or your mobile network after successfully configuring WLAN.

9 EMERGENCIES

9.1 Emergency Procedures

Turn off the main grid breaker directly feeding the inverter and turn off all inverter switches if the WH-THA inverter appears to be malfunctioning. Please immediately contact eCactus for detailed instructions.

WARNING: Do not open the inverter upper cover plate by yourself.

9.2 First Aid Procedures

Avoid touching any liquid or gas leaking out of battery modules. Immediately do the following upon exposure to leaked battery liquids or gases:

Skin contact: Remove any contaminated clothes and rinse the affected area with plenty of water or run it under a shower for at least 15 minutes. Seek medical attention immediately.

Eye contact: Immediately flush the eyes with plenty of water for at least 15 minutes, occasionally lifting the upper and lower eyelids. Seek medical attention immediately.

Inhalation: Cover the victim in a blanket, move them into the fresh air, and keep them calm. Seek medical attention immediately. Begin artificial respiration immediately in the event of shortness of breath or difficulty breathing, or asphyxia (choking).

Ingestion: Give the patient at least 2 glasses of milk or water to drink. Induce vomiting unless the patient is unconscious. Seek medical attention immediately.

9.3 Firefighting Measures

Extinguishing media: Dry powder, sand, carbon dioxide (CO₂). Fire precautions and protective measures:

Flammable properties: Lithium-ion batteries contain a flammable liquid electrolyte that may vent, ignite, or produce sparks when subjected to high temperatures (> 150°C) or when damaged or improperly used (e.g., mechanical damage or overcharging). Burning cells can ignite other batteries close by.


Explosion data: Severe mechanical abuse may rupture batteries. Batteries may explode when exposed to fire.

Special protective equipment for firefighters: Wear full protective gear and self-contained breathing apparatus with a full face mask in a pressure-demand or other positive pressure mode in case of fire.

10 Remarks

10.1 Recycle and Disposal

In case a battery (normal condition or damaged) needs disposal or needs recycling, it shall follow the local recycling regulation (i.e. Regulation (EC) N° 1013/2006 among European Union) to process and using the best available techniques to achieve a relevant recycling efficiency.



10.2 Maintenance

- 1) It is required to charge the battery at least once every 6 months, for this charge maintenance make sure the SOC is charged to higher than 85%.
- 2) Check installation environment such as dust, water, insect etc. Make sure it is suitable for IP65 battery system. Connection of power connector, grounding point, power cable and screw are suggested to be checked every year